

ПАПКА 17

ПРИЛОЖЕНИЕ 10 Други документи за  
Позиция 1 и Позиция 2

ПРИЛОЖЕНИЕ 10.8 Комплект клемен блок  
и стопяеми цилиндрични предпазител-прекъсвач-  
разединители

Приложение 1

Приложение 2

Приложение 3

Приложение 4

Приложение 5

*0*


*12  
PH*



Extract from the online catalog


# URTK/S

Order No.: 0311087

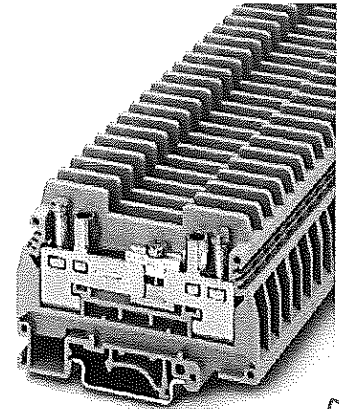


<http://eshop.phoenixcontact.net/phoenix/treeViewClick.do?UID=0311087>

Test disconnect terminal block, Connection method: Screw connection, Cross section: 0.5 mm<sup>2</sup> -10 mm<sup>2</sup>, AWG: 20 - 10, Width: 8.2 mm, Mounting type: NS 35/7.5, NS 35/15, NS 32, Color: gray

| Commercial data                          |  |
|--|--|
| EAN                                      | <br>4 017918 001292 |
| Pack                                     | 50 pcs.  |
| Customs tariff                           | 85369010   |
| Gross weight in pieces                   | 0.035996 KG  |
| Net weight per piece (exclusive packing) | 0.03581 KG   |
| Catalog page information                 | Page 463 (CL1-2011)  |


Product notes

WEEE/RoHS-compliant since:  
01/01/2003



<http://www.download.phoenixcontact.com>  
Please note that the data given here has been taken from the online catalog. For comprehensive information and data, please refer to the user documentation. The General Terms and Conditions of Use apply to Internet downloads.

| Technical data        |      |
|-----------------------|------|
| <b>General</b>        |      |
| Number of levels      | 1    |
| Number of connections | 2    |
| Color                 | gray |



**ВЯРНО С  
ОРИГИНАЛА**

*[Handwritten mark]*

|   |    |
|---|----|
| Insulating material                     | PA |
| Inflammability class according to UL 94 | V0 |

**Dimensions**

|                  |         |
|------------------|---------|
| Length           | 72 mm   |
| Width            | 8.2 mm  |
| Height NS 35/7,5 | 51.5 mm |
| Height NS 35/15  | 59 mm   |
| Height NS 32     | 56 mm   |

**Technical data**

|   |                                     |
|---|-------------------------------------|
| Rated surge voltage   | 6 kV                                |
| Pollution degree  | 3                                   |
| Surge voltage category  | III                                 |
| Insulating material group   | I                                   |
| Connection in acc. with standard  | IEC 60947-7-1                       |
| Nominal current $I_N$   | 41 A                                |
| Nominal voltage $U_N$   | 400 V                               |
| Open side panel   | ja                                  |
| Shock protection test specification   | DIN EN 50274 (VDE 0660-514):2002-11 |
| Back of the hand protection   | guaranteed                          |
| Surge voltage test setpoint   | 7.3 kV                              |
| Result of surge voltage test  | Test passed                         |
| Power frequency withstand voltage setpoint                                      | 1.89 kV                             |
| Result of power-frequency withstand voltage test                                | Test passed                         |
| Checking the mechanical stability of terminal points (5 x conductor connection) | Test passed                         |
| Bending test rotation speed   | 10 rpm                              |
| Bending test turns  | 135                                 |
| Bending test conductor cross section/weight                                     | 0.5 mm <sup>2</sup> / 0.3 kg        |
|   | 6 mm <sup>2</sup> / 1.4 kg          |
|   | 10 mm <sup>2</sup> / 2 kg           |
| Result of bending test  | Test passed                         |
| Conductor cross section tensile test  | 0.5 mm <sup>2</sup>                 |
| Tractive force setpoint   | 20 N                                |
| Conductor cross section tensile test  | 6 mm <sup>2</sup>                   |
| Tractive force setpoint   | 80 N                                |

|   |                    |
|---|--------------------|
| Conductor cross section tensile test                                  | 10 mm <sup>2</sup> |
| Tractive force setpoint   | 90 N               |
| Tensile test result   | Test passed        |
| Tight fit on carrier  | NS 32/NS 35        |
| Setpoint  | 5 N                |
| Result of tight fit test  | Test passed        |
| Result of voltage drop test   | Test passed        |
| Temperature-rise test   | Test passed        |
| Conductor cross section short circuit testing                         | 6 mm <sup>2</sup>  |
| Short-time current  | 0.72 kA            |
| Conductor cross section short circuit testing                         | 10 mm <sup>2</sup> |
| Short-time current  | 1.2 kA             |
| Short circuit stability result  | Test passed        |
| Proof of thermal characteristics (needle flame) effective duration    | 30 s               |
| Result of thermal test  | Test passed        |
| Temperature index, insulating material (DIN EN 60216-1 (VDE 0304-21)) | 130 °C             |
| Static insulating material application in cold                        | -60 °C             |

**Connection data**

|  |                     |
|--|---------------------|
| Conductor cross section solid min.   | 0.5 mm <sup>2</sup> |
| Conductor cross section solid max.   | 10 mm <sup>2</sup>  |
| Conductor cross section stranded min.                                      | 0.5 mm <sup>2</sup> |
| Conductor cross section stranded max.                                      | 6 mm <sup>2</sup>   |
| Conductor cross section AWG/kcmil min.                                     | 20                  |
| Conductor cross section AWG/kcmil max                                      | 8                   |
| Conductor cross section stranded, with ferrule without plastic sleeve min. | 0.5 mm <sup>2</sup> |
| Conductor cross section stranded, with ferrule without plastic sleeve max. | 6 mm <sup>2</sup>   |
| Conductor cross section stranded, with ferrule with plastic sleeve min.    | 0.5 mm <sup>2</sup> |
| Conductor cross section stranded, with ferrule with plastic sleeve max.    | 4 mm <sup>2</sup>   |
| 2 conductors with same cross section, solid min.                           | 0.5 mm <sup>2</sup> |
| 2 conductors with same cross section, solid max.                           | 2.5 mm <sup>2</sup> |
| 2 conductors with same cross section, stranded min.                        | 0.5 mm <sup>2</sup> |

**ВЯРНО С  
 ОРИГИНАЛА**

*Handwritten signature*

|   |                     |
|---|---------------------|
| 2 conductors with same cross section, stranded max.                                     | 6 mm <sup>2</sup>   |
| 2 conductors with same cross section, stranded, ferrules without plastic sleeve, min.   | 0.5 mm <sup>2</sup> |
| 2 conductors with same cross section, stranded, ferrules without plastic sleeve, max.   | 4 mm <sup>2</sup>   |
| 2 conductors with same cross section, stranded, TWIN ferrules with plastic sleeve, min. | 0.5 mm <sup>2</sup> |
| 2 conductors with same cross section, stranded, TWIN ferrules with plastic sleeve, max. | 4 mm <sup>2</sup>   |
| Connection method   | Screw connection    |
| Stripping length  | 13 mm               |
| Internal cylindrical gage   | A5                  |
| Screw thread  | M4                  |
| Tightening torque, min  | 1.2 Nm              |
| Tightening torque max   | 1.5 Nm              |

**Certificates / Approvals**

Certification

CSA, cULus Recognized, GOST, KEMA-KEUR, DNV, LR, PRS, RS, CCA

Certifications applied for:

Certification Ex:

**Accessories**

| Item            | Designation | Description   |
|-----------------|-------------|---|
| <b>Assembly</b> |             |   |
| 3034361         | AP-ME METER | Cover profile, for covering terminal strips, snapped onto APT-ME cover profile carrier or APH-ME end bracket. A cover profile carrier should be positioned at the ends and at intervals of around 40 cm. Length supplied: 1 m |
| 3034374         | APH-ME      | Cover profile carrier for mounting on NS 35/7.5 DIN rail for attaching the cover profile AP-ME  |
| 3034358         | APT-ME      | Cover profile carrier for mounting on NS 35/7.5 DIN rail for attaching the cover profile AP-ME  |

|         |                             |   |
|---------|-----------------------------|---|
| 0310224 | ATS-RTK                     | Partition plate, Length: 72 mm, Width: 0.8 mm, Height: 51.5 mm, Color: gray   |
| 3022218 | CLIPFIX 35                  | Snap-on end bracket, for 35 mm NS 35/7.5 or NS 35/15 DIN rail, can be fitted with Zack strip ZB 8 and ZB 8/27, terminal strip marker KLM 2 and KLM, width: 9.5 mm, color: gray  |
| 3022276 | CLIPFIX 35-5                | Quick mounting end clamp for NS 35/7,5 DIN rail or NS 35/15 DIN rail, can be fitted with ZB 5 and ZBF 5 zack marker strip, KLM 2, KLM3, and KML3L terminal strip marker, parking option for FBS...5, FBS...6, KSS 5, KSS 6, width: 5.15 mm, color: gray |
| 0310020 | D-URTK                      | End cover, Length: 72 mm, Width: 2.2 mm, Height: 41.5 mm, Color: gray   |
| 1201442 | E/UK                        | End clamp, for assembly on NS 32 or NS 35/7.5 DIN rail  |
| 1201413 | E/UK 1                      | End clamps, for supporting the ends of double-level and three-level terminal blocks, width: 10 mm, color: gray  |
| 1201002 | NS 32 PERF 2000MM           | G-profile DIN rail, material: Steel, perforated, height 15 mm, width 32 mm, length 2 m  |
| 1201015 | NS 32 UNPERF 2000MM         | G-profile DIN rail, material: Steel, unperforated, height 15 mm, width 32 mm, length 2 m  |
| 0801704 | NS 35/ 7,5 AL UNPERF 2000MM | DIN rail, material: Aluminum, unperforated, height 7.5 mm, width 35 mm, length: 2 m   |
| 1206560 | NS 35/ 7,5 CAP              | DIN rail end piece, for DIN rail NS 35/7.5  |
| 0801762 | NS 35/ 7,5 CU UNPERF 2000MM | DIN rail, material: Copper, unperforated, height 7.5 mm, width 35 mm, length: 2 m   |
| 0801733 | NS 35/ 7,5 PERF 2000MM      | DIN rail, material: steel galvanized and passivated with a thick layer, perforated, height 7.5 mm, width 35 mm, length: 2000 mm   |
| 0801681 | NS 35/ 7,5 UNPERF 2000MM    | DIN rail, material: Steel, unperforated, height 7.5 mm, width 35 mm, length: 2 m  |
| 1204119 | NS 35/ 7,5 WH PERF 2000MM   | DIN rail 35 mm (NS 35)  |
| 1204122 | NS 35/ 7,5 WH UNPERF 2000MM | DIN rail 35 mm (NS 35)  |
| 1206421 | NS 35/ 7,5 ZN PERF 2000MM   | DIN rail, material: Galvanized, perforated, height 7.5 mm, width 35 mm, length: 2 m   |
| 1206434 | NS 35/ 7,5 ZN UNPERF 2000MM | DIN rail, material: Galvanized, unperforated, height 7.5 mm, width 35 mm, length: 2 m   |
| 1201756 | NS 35/15 AL UNPERF 2000MM   | DIN rail, deep drawn, high profile, unperforated, 1.5 mm thick, material: aluminum, height 15 mm, width 35 mm, length 2000 mm   |
| 1206573 | NS 35/15 CAP                | DIN rail end piece, for DIN rail NS 35/15   |
| 1201895 | NS 35/15 CU UNPERF 2000MM   | DIN rail, material: Copper, unperforated, 1.5 mm thick, height 15 mm, width 35 mm, length: 2 m  |
| 1201730 | NS 35/15 PERF 2000MM        | DIN rail, material: steel galvanized and passivated with a thick layer, perforated, height 15 mm, width 35 mm, length: 2000 mm  |
| 1201714 | NS 35/15 UNPERF 2000MM      | DIN rail, material: Steel, unperforated, height 15 mm, width 35 mm, length: 2 m   |

|         |                            |   |
|---------|----------------------------|---|
| 0806602 | NS 35/15 WH PERF 2000MM    | DIN rail 35 mm (NS 35)  |
| 1204135 | NS 35/15 WH UNPERF 2000MM  | DIN rail 35 mm (NS 35)  |
| 1206599 | NS 35/15 ZN PERF 2000MM    | DIN rail, material: Galvanized, perforated, height 15 mm, width 35 mm, length: 2 m            |
| 1206586 | NS 35/15 ZN UNPERF 2000MM  | DIN rail, material: Galvanized, unperforated, height 15 mm, width 35 mm, length: 2 m          |
| 1201798 | NS 35/15-2,3 UNPERF 2000MM | DIN rail, material: Steel, unperforated, 2.3 mm thick, height 15 mm, width 35 mm, length: 2 m |
| 0310211 | TS-RTK                     | Separating plate, Length: 72 mm, Width: 0.8 mm, Color: gray                                   |

**Bridges**

|         |              |  |
|---------|--------------|--|
| 0311281 | ASB 2-RTK/S  | Switching jumper, Number of positions: 2, Color: silver    |
| 0202154 | EB 2- 8      | Insertion bridge, Number of positions: 2, Color: gray      |
| 0202141 | EB 3- 8      | Insertion bridge, Number of positions: 3, Color: gray      |
| 0202142 | EB 4- 8      | Insertion bridge, Number of positions: 4, Color: gray      |
| 0202138 | EB 10- 8     | Insertion bridge, Number of positions: 10, Color: gray     |
| 0311171 | FB 10- RTK/S | Fixed bridge, Number of positions: 10, Color: silver       |
| 0308359 | S            | Switching lock, Length: 12 mm, Width: 8.2 mm, Color: white |
| 0311236 | SB 2-RTK/S   | Switching jumper, Number of positions: 2, Color: silver    |
| 0311265 | SB 4-RTK/S   | Switching jumper, Number of positions: 4, Color: silver    |
| 0311278 | USB 2-RTK/S  | Switching jumper, Number of positions: 2, Color: silver    |

**General**

|         |           |                                       |
|---------|-----------|---------------------------------------|
| 0800886 | E/NS 35 N | End clamp, width: 9.5 mm, color: gray |
|---------|-----------|---------------------------------------|

**Marking**

|         |                  |   |
|---------|------------------|---|
| 1007235 | SBS 8:UNBEDRUCKT | Marker cards, Card, white, Unlabeled, Can be labeled with: Plotter, Mounting type: Snap into tall marker groove, Snap into flat marker groove, For terminal block width: 8.2 mm, Lettering field: 6 x 8.1 mm                                  |
| 0818072 | UC-TM 8          | Marker for terminal blocks, Sheet, white, Unlabeled, Can be labeled with: BLUEMARK CLED, Bluemark, Plotter, Mounting type: Snap into tall marker groove, For terminal block width: 8.2 mm, Lettering field: 7.6 x 10.5 mm                     |
| 0824597 | UC-TM 8 CUS      | Marker for terminal blocks, Can be ordered: By sheet, white, Labeled according to customer specifications, Mounting type: Snap into tall marker groove, For terminal block width: 8.2 mm, Lettering field: 7.6 x 10.5 mm                      |
| 0828740 | UCT-TM 8         | Marker for terminal blocks, Sheet, white, Unlabeled, Can be labeled with: Thermomark C+, Thermomark C, BLUEMARK CLED, Bluemark, Mounting type: Snap into tall marker groove, For terminal block width: 8.2 mm, Lettering field: 7.6 x 10.5 mm |

|         |                 |  |
|---------|-----------------|--|
| 0829616 | UCT-TM 8 CUS    | Marker for terminal blocks, Can be ordered: By sheet, white, Labeled according to customer specifications, Mounting type: Snap into tall marker groove, For terminal block width: 8.2 mm, Lettering field: 7.6 x 10.5 mm |
| 0825011 | ZB 8 CUS        | Zack marker strip, Can be ordered: Strip, white, Labeled according to customer specifications, Mounting type: Snap into tall marker groove, For terminal block width: 8.2 mm, Lettering field: 10.5 x 8.15 mm            |
| 1052002 | ZB 8:UNBEDRUCKT | Zack marker strip, Strip, white, Unlabeled, Can be labeled with: Plotter, Mounting type: Snap into tall marker groove, For terminal block width: 8.2 mm, Lettering field: 10.5 x 8.15 mm                                 |

**Plug/Adapter**

|         |                |                                      |
|---------|----------------|--------------------------------------|
| 0311728 | PSBJ-URTK/S BK | Female test connector, Color: black  |
| 0311757 | PSBJ-URTK/S BU | Female test connector, Color: blue   |
| 0311760 | PSBJ-URTK/S GN | Female test connector, Color: green  |
| 0311744 | PSBJ-URTK/S RD | Female test connector, Color: red    |
| 0311773 | PSBJ-URTK/S VT | Female test connector, Color: violet |
| 0311731 | PSBJ-URTK/S YE | Female test connector, Color: yellow |

**Tools**

|         |                 |  |
|---------|-----------------|--|
| 1205066 | SZS 1,0X4,0 VDE | Screwdriver, bladed, VDE insulated, size: 1.0 x 4.0 x 100 mm, 2-component grip, with non-slip grip |
|---------|-----------------|--|

ВЯРНО С  
ОРИГИНАЛА




*Mis*



**Diagrams/Drawings**

Circuit diagram

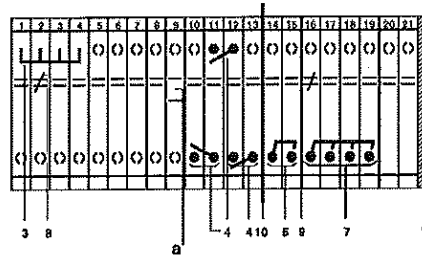

- a = open
- 1 = cover
- 3 = fixed bridge
- 4 = switch bar, for 2 terminal blocks, useable on both sides of the disconnect point, inward switching motion
- 5 = switch bar, for 2 terminal blocks, useable on both sides of the disconnect point, outward switching motion
- 7 = switch bar, for 3-phase short-circuiting of linked current transformer sets, only on the right
- 8 = switching lock, prevents disconnect slide from being actuated
- 9 = separating plate, for electrical separation of neighboring bridges in terminal center
- 10 = partition plate


*Handwritten signature or mark.*

**ВЯРНО С  
ОРИГИНАЛА**


*Handwritten signature and circular stamp.*

*Handwritten signature.*

Schematic diagram

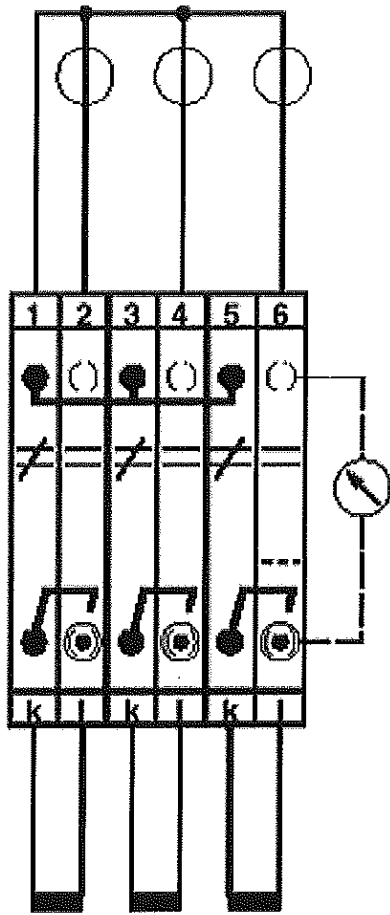



Three-phase transducer test set

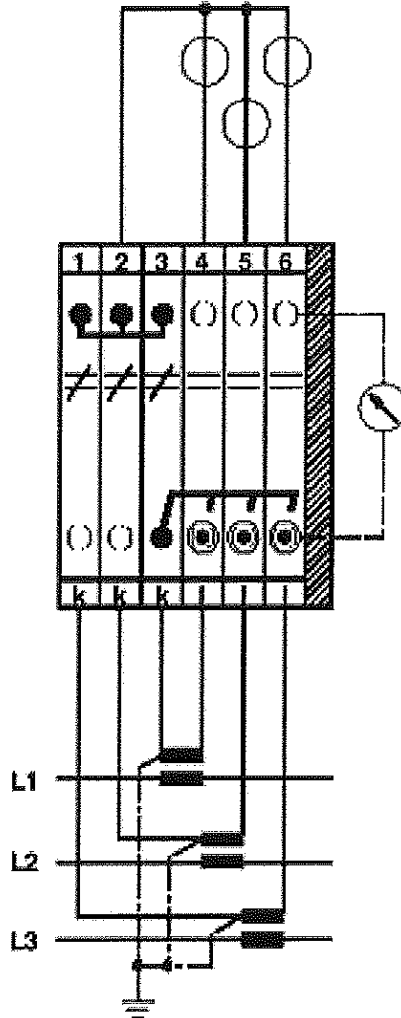

Three-phase linked transducer test set

ВЯРНО С  
ОРИГИНАЛА



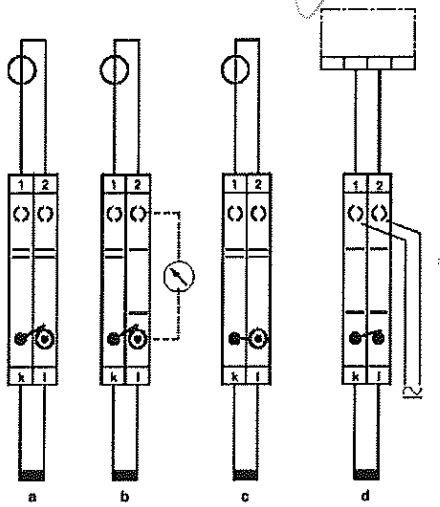

Simple current transformer test circuit

- a = normal operation
- b = measured value testing
- c = transformer short-circuit
- d = relay testing

ВЯРНО С  
ОРИГИНАЛА

URTK/S Order No.: 0311087

<http://eshop.phoenixcontact.net/phoenix/treeViewClick.do?UID=0311087>

Address


PHOENIX CONTACT GmbH & Co. KG  
Flachsmarktstr. 8  
32825 Blomberg, Germany  
Phone +49 5235 3 00  
Fax +49 5235 3 41200  
<http://www.phoenixcontact.com>



© 2013 Phoenix Contact  
Technical modifications reserved;

ВЯРНО С  
ОРИГИНАЛА

2 ph

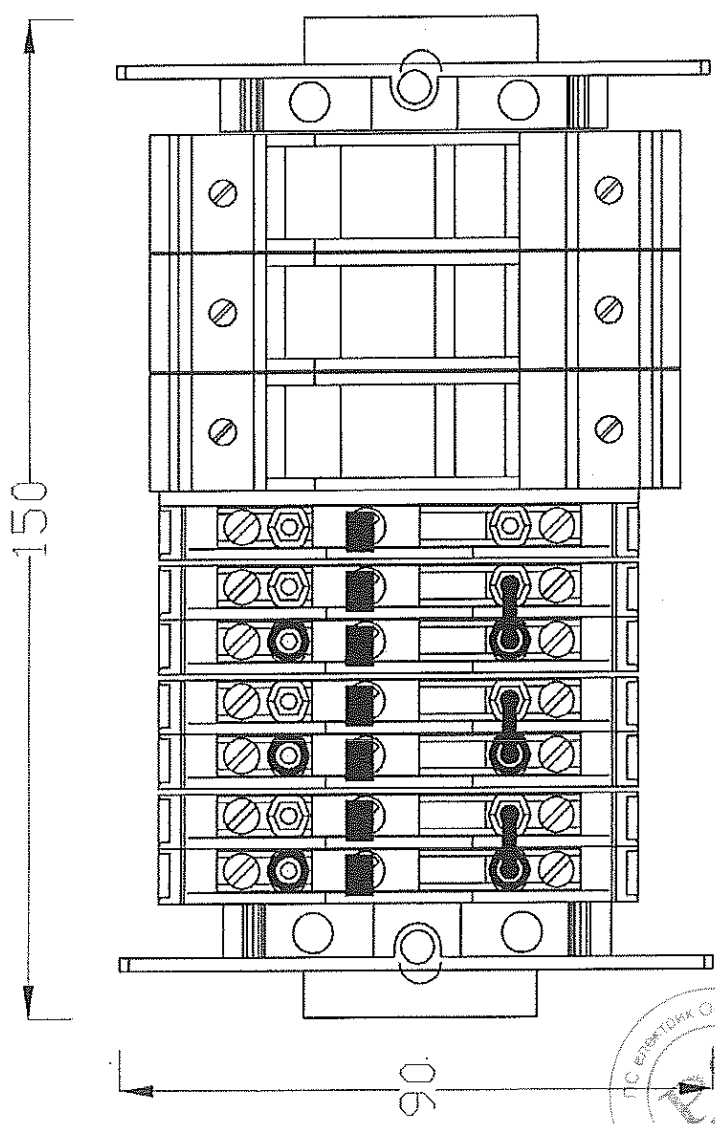

ВИБ Изоматик ООД  
 1680 София, ул. "Пивни" №404  
 тел. 02 958 63 48, 958 63 44, 958 31 11, факс 958 22 70

ОБЕКТИ измервателен кленоред ЧЕЗ



лист №: 1/ 1  
 мащаб: -

СЪЛАСУВАЛИ

ВЪЗЛОЖИТЕЛ


Чертог

Р-л електр. инж. Вл. Додарова

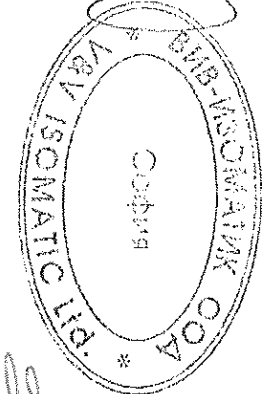

ВЯРНО С  
 ОРИГИНАЛА

*Handwritten signature*



Handwritten signature or mark.

## ТЕХНИЧЕСКИ ХАРАКТЕРИСТИКИ

Предлаганите клеми са производство на фирма Phoenix Contact – Германия. Фирмата е сертифицирана по ISO 9001. Клемите са тествани и са в съответствие с IEC 60 947-7-1, IEC 60947-1, IEC 60695-2-2, EN 50019, а също така притежават и други сертификати, които са дадени за всяка клема в каталога.

Клемите на Phoenix Contact са с универсална основа за закрепване както към симетрична шина NS 35/7,5, NS 35/15, така и към несиметрична - NS 32. Кабелните входове на клемата са затворени фунии, което улеснява въвеждането на проводника. Всички клеми имат гнезда за индивидуално и рационално маркиране.

Предлаганите клеми, производство на Phoenix Contact притежават следните по-важни качества:

**- всички метални части са устойчиви на електролитна корозия и ръжда**

Всички метални елементи на клемите са изработени от медна сплав, с високо съдържание на мед, като напълно се избягва използването на стомана. Това елиминира две възможни причини за корозия: Едната е електролитна корозия, която възниква между медния проводник и стоманата, при наличие на влага. Втората е ръждата и последиците от нея – ненадежден електрически контакт, блокирани винчетата. Използването само на медна сплав има и допълнителни предимства като: 1) ниско температурно повишение, поради високата електрическа проводимост и 2) по-малко вероятно е разхлабване на винчетата, тъй като практически няма относително термично разширение между проводника и притискащата част. Повърхността на металните части е защитена с калаено или никелово галванично покритие.


**- блокиране на винчетата срещу саморазвиване**

Phoenix Contact притежава патент, наречен "Reakdyn principle" за предпазване на винчетата от саморазвиване. Конструкцията на притискащата част е на принципа на движеща се клетка. При завъртане на винта, той натиска тоководещата част и издърпва проводника в клетката към тоководещата част. Поради високата притискаща сила проводника се интегрира в мекото калаено покритие на тоководещата част. Така се постига контактно съпротивление което превишава изискванията на IEC 60 947-7-1, като за клема 4 mm<sup>2</sup> то е 0,3mΩ.

Поради специалната си форма при затягане на винчето горната част на клетката се деформира еластично и предизвиква нарастваща триеща сила в главата на винчето, която не му позволява да се саморазвие.

**- надежна механична и електрическа връзка, съгласно IEC 60 947-7-1**

Конструкцията на притискащата част на клемата не само удовлетворява тези изисквания, но дори ги надвишава, поради следните качества: 1) Равната основа на притискащата част гарантира, че дори и най тънкия проводник ще бъде стегнат както трябва., 2) напречните жлебове на тоководещата част гарантират нарушаване оксидацията по проводника, без да го извиват и така осигуряват добър контакт, 3) стабилната конструкция на притискащите части, заедно с високата точност при изработка, осигуряват връзка, недопускаща проникването на газ, както и голяма



Handwritten signature or mark.

сила на притискане. Това означава, че условията за контакт могат да се поддържат стабилни за дълъг период от време, дори в агресивна атмосфера.

#### - качества на изолационния материал

Изолационния материал на клемите, които са предмет на настоящия търг е Полиамид 6.6. Този материал е одобрен от всички оторизирани лаборатории като CSA, NEMKO, KEMA, VDE и др. Той има отлични електрически, механични, химически и други качества, дори при високи температури. Позволен са кратковременно температури до 200° С. Полиамида абсорбира вода до 2,8%, но тази влага не е във формата на кристализирана вода в пластмасата, а е химически свързана в молекулната структура. Това прави пластмасата гъвкава и нечуплива, дори при ниски температури от -40° С. Полиамида има клас на негоримост V0, съгласно UL 94.

Максималния допустим ток на клемите зависи от максимално допустимото сечение на проводника и е в съответствие с IEC 60947-7-1.

#### Съответствие на техническите изисквания

Съгласно горното, предлаганите клеми притежават следните характеристики в съответствие с техническите изисквания:

1. Проводниците се присъединяват към клемите чрез винтова връзка, осигуряваща необслабваща електрическа връзка при вибрации и стареене;
2. Проводимите и притискащи части са устойчиви срещу електролитна корозия и ръжда. Гарантиран клас на негоримост – V0 съгласно UL 94;
3. Повишена механична устойчивост;
4. Изолационният материал не абсорбира влага;
5. Клемите са с гнезда за поставяне на етикети от двете страни;
6. Клемите се монтират върху универсална монтажна рейка. Възможен е монтаж както към симетрична шина NS 35/7,5, NS 35/15, така и към несиметрична - NS 32
7. Токови клеми:
  - Пофазно шунтиране на токовите вериги към ТТ с подвижни (фиксиращи към клемата) или преносими изолирани мостове, съгласно приложената схема;
  - Видимо разкъсване на токовите вериги след шунтиране;
  - Включване на товарно устройство за тестване – монтирана или с възможност за монтаж на тест бокс с диаметър 4mm;
  - Видимо разделяне на токовите вериги по предназначение (ядра);
8. Напреженови вериги:
  - Видимо разкъсване ;
  - Включване на товарно устройство за тестване – монтирана или с възможност за монтаж на тест бокс с диаметър 4mm;
  - Възможност за видимо разделяне на напрежените вериги по фази и предназначение;
  - Възможност за включване на измервателни уреди от двете страни на клемата;

ВЯРНО С  
ОРИГИНАЛА

ПС ЕЛЕКТРИК ООД  
БЕЛТИНС  
БУДУРА

*Handwritten signature*

## Кратко описание на предложените клеми и аксесоари към тях

### 1. URTK/S

Клеми с винтова връзка за присъединяване на кръгъл твърд проводник до  $10\text{mm}^2$  или гъвкав проводник с/без накрайник до  $6\text{mm}^2$ . Клемата е с възможност за фиксирано разкъсване на връзката, с гнезда за присъединяване на тестови проводници или за поставяне на шунтиращи мостчета от двете страни на клемата - щифт 4mm. Тази клема е универсална и удовлетворява всички изисквания за яснота на веригата, удобства за превключване. Клемата предлага няколко типа на замостване: чрез конектори с изолирана ръкохватка (2, 4 поз.), превключващи мостове (2, 4 поз.) за окъсяване на трансформаторни вериги, фиксиран мост – 10 позиционен, делим, окомплектован с винтове. Гнездата за тестови проводник или шунтиращ конектор всяка страна са независими от винта за присъединяване на проводника.

### 2. URTK/SP

Клеми с винтова връзка за присъединяване на кръгъл твърд проводник до  $10\text{mm}^2$  или гъвкав проводник с/без накрайник до  $6\text{mm}^2$ . Клемата е с възможност за фиксирано разкъсване на връзката, с гнезда за присъединяване на тестови проводници или за поставяне на шунтиращи мостчета от двете страни на клемата - щифт 4mm. Тази клема е универсална и удовлетворява всички изисквания за яснота на веригата, удобства за превключване и защита от допир до тоководещи части. Клемата предлага няколко типа на замостване: чрез изолирани превключващи мостове (2, 3, 4, 10 поз.), неизолиран фиксиран мост, конектори с изолирана ръкохватка (2, 4 поз.) Гнездата за тестови проводник или шунтиращ конектор са напълно изолирани.

### 3. D-URTK

Крайна капачка за клема URTK/S.

### 4. Разделителна пластина ATP-URTK/SP.

Секционна разделителна пластина за визуално и електрическо разделяне на клемни групи за директен монтаж на DIN шина. Дебелина: 2 мм.

Подходяща за използване с всички токови и напреженови клеми.

### 5. Шунтиращ мост SB 2-RTK/S.

Двупозиционен подвижен, шунтиращ мост за клеми URTK/S.

### 6. Шунтиращ мост SB 2-URTK/SP.

Двупозиционен изолиран, подвижен, шунтиращ мост за клеми URTK/SP.

### 7. Фиксатор за клемен пакет CLIPFIX 35.

Фиксатор със защипване за симетрични шини 35/7,5 мм, 35/15 мм.

Ширина: 9,5 мм. Материал: полиамид.


Клас на запалимост: V0. Цвят: сив.

Може да се маркира със стандартни клемни маркировки ZB, маркировки: KLM, KLM 2.

Със

На основание чл. 2  
от ЗЗЛД

ВЯРНО С  
ОРИГИНАЛА

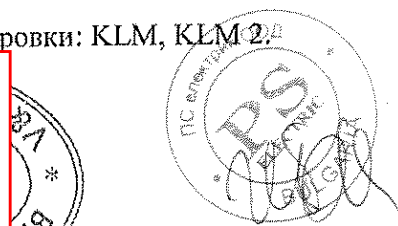


Handwritten mark at the bottom of the page.



V

10.8.3  
Ph



## ДЕКЛАРАЦИЯ ЗА СЪОТВЕТСТВИЕ

Долуподписаният, Владимир Лазаров- Управител на ВИБ-ИЗОМАТИК ООД,

В качеството си на търговски представител на Phoenix Contact GmbH и Lovato Electric за България

Декларирам че, материалите, с които се асемблират клемореди тип ИК7ТКЗР, отговарят на следните стандарти и нормативни актове:

-Клеми тип URTK/S и аксесоари за тях, производство на Phoenix Contact GmbH отговарят на следните технически одобрения и нормативни актове IEC 60947-7-1

-Разединяеми предпазител-разединители тип FB1, производство на Lovato Electric отговарят на следните технически одобрения и нормативни актове : IEC/EN 60269-1, IEC/EN 60269-2, IEC/EN 60947-1, IEC/EN 60947-3.

Handwritten signature and arrow pointing to the text above.

На основание чл. 2  
от ЗЗЛД

25.10.2013

ВЯРНО С  
ОРИГИНАЛА

Handwritten signature and circular stamp.

Handwritten signature.

# CERTIFICATE

KEMA No.: 97.4117.13

Issued to:  
Applicant:  
**Phoenix Contact GmbH & Co.**  
**Flachmarktstrasse 8-28**  
**BLOMBERG, Germany**

Manufacturer/Licensee:  
**Phoenix Contact GmbH & Co.**  
**Flachmarktstrasse 8-28**  
**BLOMBERG, Germany**

Product : terminal blocks

Trade name : PHOENIX CONTACT  
Types/models : URTK/S-BEN BU, URTK/S-BEN, URTK/S, URTK/SP,  
USLKG 10, USLKG 6N

The product and any acceptable variation thereto is specified in the Annex to this certificate and the documents therein referred to.

KEMA hereby declares that the above-mentioned product has been certified on the basis of:

- a type test according to the standard EN 60947-7-1:1991, EN 60947-7-2:1995
- an inspection of the production location according to CCA Group Operational Document CCA 204
- a certification agreement with the number 900469

KEMA hereby grants the right to use the KEMA certification mark



The KEMA-KEUR certification mark may be applied to the product as specified in this certificate for the duration of the KEMA-KEUR certification agreement and under the conditions of the KEMA-KEUR certification agreement.

This certificate is issued on: August 6, 1999

На основание чл. 2  
от ЗЗЛД

ВАРНО С  
ОРИГИНАЛА

is certificate is allowed



*Handwritten signature*

**SPECIFICATION OF THE CERTIFIED PRODUCT**

**Product data**

product : terminal blocks  
 trade name : PHOENIX CONTACT  
 types : URTK/S-BEN BU, URTK/S-BEN, URTK/S,  
 URTK/SP, USLKG 10, USLKG 6N  
 material : thermoplastic material  
 mounting : top hat rail 35 mm (EN 50022) and G-profile  
 rail 32 mm (EN 50035)

**Additional information**

**Markings**

Trademark, type designation, rated connection capacity and rated insulation voltage are indented in the insulation material.

**Product data – type USLKG 6N**

rated connection capacity : 6 mm<sup>2</sup>  
 connectable conductors : one conductor  
 0,2 - 10 mm<sup>2</sup> solid  
 0,2 - 6 mm<sup>2</sup> flexible without ferrule  
 0,25 - 6 mm<sup>2</sup> flexible with ferrule  
 two conductors  
 0,2 - 2,5 mm<sup>2</sup> solid  
 0,2 - 2,5 mm<sup>2</sup> flexible without ferrule  
 0,25 - 1,5 mm<sup>2</sup> flexible with ferrule  
 description : protective conductor terminal block with 2  
 screw-type clamping units, 1-pole


**Product data – type URTK/S**

rated voltage : 400 V  
 rated connection capacity : 6 mm<sup>2</sup>  
 connectable conductors : one conductor  
 0,5 - 10 mm<sup>2</sup> solid  
 0,5 - 6 mm<sup>2</sup> flexible without ferrule  
 0,5 - 10 mm<sup>2</sup> flexible with ferrule  
 two conductors  
 0,5 - 2,5 mm<sup>2</sup> solid  
 0,5 - 6 mm<sup>2</sup> flexible without ferrule  
 0,5 - 4 mm<sup>2</sup> flexible with ferrule  
 rated impulse withstand voltage : 6 kV  
 description : disconnect terminal block with 2 screw-type  
 clamping units, 1-pole

**N.V. KEMA**

Utrechtseweg 310, 6812 AR Arnhem, The Netherlands  
 P.O. Box 9035, 6800 ET ARNHEM, The Netherlands  
 Telephone +31 26 3562850, Telefax +31 26 3514922

ВЯРНО С  
 ОРИГИНАЛА



*liis*



**Product data – type URTK/SP**

rated voltage : 500 V  
rated connection capacity : 6 mm<sup>2</sup>  
connectable conductors : one conductor  
0,5 - 10 mm<sup>2</sup> solid  
0,5 - 6 mm<sup>2</sup> flexible without ferrule  
0,5 - 6 mm<sup>2</sup> flexible with ferrule  
two conductors  
0,5 - 2,5 mm<sup>2</sup> solid  
0,5 - 4 mm<sup>2</sup> flexible without ferrule  
0,5 - 2,5 mm<sup>2</sup> flexible with ferrule  
rated impulse withstand voltage : 6 kV  
description : disconnect terminal block with 2 screw-type  
clamping units, 1-pole

**TESTS****Test requirements**

EN 60947-7-1:1991 + C:1997-06 + A11:1997  
EN 60947-7-2:1995 + C:1996-01

**Test results**

The test results are laid down in KEMA test file 97.4117.13.

**Conclusion**

The examination proved that all test requirements are met.

На основании чл. 2  
от ЗЗЛД

Tested by : H.L. Schouten

Checked by : L.J.W. van der Wal

**FACTORY-LOCATION(S)**

Phoenix Contact GmbH & Co.  
Flachsmarktstrasse 8-28, BLOMBERG, Germany

**N.V. KEMA**

Utrechtseweg 310, 6812 AR Arnhem, The Netherlands  
P.O. Box 9035, 6800 ET ARNHEM, The Netherlands  
Telephone +31 26 3562850, Telefax +31 26 3514922

ВЯРНО С  
ОРИГИНАЛА



Annex to ISO/IEC 17025:2005 declaration of accreditation for registration number: **L 022**

5  
Ph

of **DEKRA Certification B.V.**

This annex is valid from: **29-04-2015** to **01-03-2018**

Replaces annex dated: **03-11-2014**

**Location where activities are performed under accreditation**

**Head Office**

Meander 1051  
6825 MJ  
Arnhem  
The Netherlands

| No. | Material or product | Type of activity | Reference number | Remarks |
|-----|---------------------|------------------|------------------|---------|
|-----|---------------------|------------------|------------------|---------|

**A. Electrical Safety Tests**

|    |                                   |   |   |                      |
|----|-----------------------------------|---|---|----------------------|
| 1a | Cables and cords<br><b>(CABL)</b> | Type test of cables and cords according to the tests in the standard, among others:<br><br>- electrical safety tests<br><br>- mechanical tests<br><br>- environmental tests | HD 21<br>HD 22<br>HD 603<br>HD 604<br>HD 605<br><br>EN 13501, EN 50143;<br>EN 50214; EN 50267;<br>EN 50525; EN 50288;<br>EN 50399; EN 50618<br><br>NEN/EN 50200<br>NEN/EN/IEC 60228<br>NEN-EN 50525<br>NEN/EN 50266<br>NEN/EN 50362<br>NEN/EN /IEC 61034<br><br>IEC 60092; IEC 60227 *;<br>IEC 60245 *; IEC 60331;<br>IEC 60332; IEC 60502-1;<br>IEC 60502-2; IEC 60754;<br>IEC 60800; IEC 60840<br>IEC 62067 | * see note 3<br><br> |
|----|-----------------------------------|---|---|----------------------|

**ВЯРНО С  
ОРИГИНАЛА**

На основание чл. 2  
от ЗЗЛД

This an


Annex to ISO/IEC 17025:2005 declaration of accreditation for registration number: **L 022**

of **DEKRA Certification B.V.**

This annex is valid from: **29-04-2015** to **01-03-2018**

Replaces annex dated: **03-11-2014**

| No. | Material or product               | Type of activity  | Reference number   | Remarks      |
|-----|-----------------------------------|---|--|--------------|
| 1a  | Cables and cords<br><b>(CABL)</b> | Type test of cables and cords according to the tests in the standard, among others:<br><br>- electrical safety tests<br><br>- mechanical tests<br><br>- environmental tests | DEKRA K 42; DEKRA K 102<br>DEKRA K 145; DEKRA K 146<br>DEKRA K 151; DEKRA K 152<br>DEKRA K 156; DEKRA K 157<br>DEKRA K 158; DEKRA K 160<br>DEKRA K 161; DEKRA K 162<br>DEKRA K 163; DEKRA K 164<br>DEKRA K 165; DEKRA K 167<br>DEKRA K 168; DEKRA K 169<br>DEKRA K 170; DEKRA K 171<br>DEKRA K 175; DEKRA K 176<br>DEKRA K 177; DEKRA K 178<br>DEKRA K 179<br><br>BS 6004; BS 6007; BS 4553;<br>BS 5467; BS 6231; BS 6346;<br>BS 6387; BS 6500; BS 6622;<br>BS 6724; BS 6883; BS 7211;<br>BS 7629; BS 7835; BS 7846; BS 7889; BS 8491;<br><br>BS EN 50288-7<br>BS EN 50525<br><br>DIN VDE0815; DIN VDE0250 | * see note 3 |
|     |                                   | Test methods for non-metallic materials   | IEC 60811-201; IEC 60811-202<br>IEC 60811-203; IEC 60811-401<br>IEC 60811-402; IEC 60811-403<br>IEC 60811-404; IEC 60811-405<br>IEC 60811-406; IEC 60811-408<br>IEC 60811-409; IEC 60811-411<br>IEC 60811-412; IEC 60811-501<br>IEC 60811-502; IEC 60811-503<br>IEC 60811-504; IEC 60811-505<br>IEC 60811-506; IEC 60811-507<br>IEC 60811-508; IEC 60811-509<br>IEC 60811-510; IEC 60811-511<br>IEC 60811-605; IEC 60811-606<br>IEC 60811-607  |              |
|     |                                   | Electrical test methods for low voltage energy cables   | NEN-EN 50395   |              |
|     |                                   | Non electrical test methods for low voltage energy cables   | NEN-EN 50396   |              |

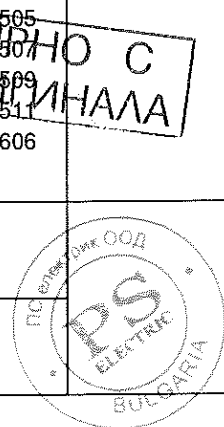

Annex to ISO/IEC 17025:2005 declaration of accreditation for registration number: **L 022**


of **DEKRA Certification B.V.**

This annex is valid from: **29-04-2015 to 01-03-2018**

Replaces annex dated: **03-11-2014**

| No. | Material or product   | Type of activity  | Reference number  | Remarks      |
|-----|---|---|---|--------------|
| 1b  | Conduits  | Type test of conduits according to the tests in the standard, among others:<br><ul style="list-style-type: none"> <li>- electrical safety tests</li> <li>- mechanical tests</li> <li>- environmental tests</li> </ul>   | NEN/EN/IEC 61386<br>DEKRA K24<br>EN 50086   |              |
| 1c  | Installation systems<br>Cable trays<br>Cable ladders  | Type test of cable trays and cable ladders, according to the tests in the standard, among others:<br><ul style="list-style-type: none"> <li>- electrical safety tests</li> <li>- mechanical tests</li> <li>- environmental tests</li> </ul>                     | KEMA 55<br>NEN/EN 50085<br>NEN/IEC/EN 61537<br>BS EN 61537  |              |
| 1d  | Boxes and enclosures for electrical installations   | Type test of boxes and enclosures for electrical installations, according to the tests in the standard, among others:<br><ul style="list-style-type: none"> <li>- electrical safety tests</li> <li>- mechanical tests</li> <li>- environmental tests</li> </ul> | NEN/EN/IEC 60670  |              |
| 2a  | Switches for appliances and automatic controls for electrical household appliances<br><b>(CONT)</b> | Type test of switches according to the tests in the standard, among others:<br><ul style="list-style-type: none"> <li>- electrical safety tests</li> <li>- mechanical tests</li> <li>- environmental tests.</li> </ul>  | IEC/EN 60730*, 61095*<br>IEC/EN 60691, 60934, 61058*, 60529<br>IEC 60265, 62271-1, 62271-100, 62271-101, 62271-102, 62271-105, 62271-110, 62271-200, 62271-201, 62271-202, 62271-203, EN 50152-1<br>IEEE Std C37.09, C37.081, 37.60, C37.013, C37.34, ANSI C37.41, C37.73, C37.20.2, C37.122<br>ANSI/IEEE C37.21<br>ANSI C37.54, C37.55, C37.20.2, C37.72 | * see note 3 |

ВАРНО С  
ОРИГИНАЛА





Annex to ISO/IEC 17025:2005 declaration of accreditation for registration number: **L 022**


of **DEKRA Certification B.V.**

This annex is valid from: **29-04-2015** to **01-03-2018**

Replaces annex dated: **03-11-2014**

| No. | Material or product  | Type of activity   | Reference number   | Remarks      |
|-----|--|--|--|--------------|
| 3   | Household and similar equipment<br><b>(HOUS)</b>                 | Type test of household equipment according to the tests in the standard, among others:<br><br>- electrical safety tests<br><br>- mechanical tests<br><br>- environmental tests                             | IEC/EN 60335*<br>IEC/EN 61770<br>IEC/EN 62233<br>EN 50366<br>IEC/EN 60204<br>IEC/EN 60730-1/2-8/2-9<br>IEC/EN 61558-1/2-3/2-6/2-5/2-6/2-16<br>IEC/EN 62061<br>EN/ISO 13849-1   | * see note 3 |
|     |  | Low power measurements   | IEC/EN 62301   |              |
| 4   | Installation accessories and connection devices<br><b>(INST)</b> | Type test of installation accessories and connection devices according to the tests in the standard, among others:<br><br>- electrical safety tests<br><br>- mechanical tests<br><br>- environmental tests | IEC/EN 60309*, 60320*, 60669*, 60670*, 60799*, 60884*, 60998*, 61058*, 61242*, 61534*, 61984*, 62208*;<br>IEC/EN 60335-2-76, 60974, 61316, 61386, 62094<br>EN 50075, 50066, 50146, 50250, 50393<br>NEN 1251,<br>IEC 60884*, 61238, 62080<br>BS 1363-1, BS 1363-2, BS 1363-3, BS 1363-4<br>SS 145<br>BS 546<br>BS 4573<br>BS 5733<br>NEN 1020<br>NF C61-314<br>DIN VDE 0620-1<br>DIN VDE 0620-2-1<br>CEI 23-50<br>NBN C 61-112-1<br>NEK IEC 60884-1<br>NEK 502<br>ÖVE/ÖNORM E 8684-1<br>ÖVE/ÖNORM E 8620-2(-3,-4, -5)<br>SFS 5610<br>SS 428 08 34<br>DS 60884-2-D1<br>SEV 1011<br>UNE 20315-1-1;<br>UNE 20315-1-2<br>IEC/EN 61535<br>EN 50428 required with 60669 | * see note 3 |

**ВЯРНО С  
ОРИГИНАЛА**



Annex to ISO/IEC 17025:2005 declaration of accreditation for registration number: **L 022**


of **DEKRA Certification B.V.**

This annex is valid from: **29-04-2015** to **01-03-2018**

Replaces annex dated: **03-11-2014**

| No. | Material or product                                  | Type of activity   | Reference number   | Remarks      |
|-----|--|--|--|--------------|
| 5   | Luminaire (LITE)                                     | Type test of luminaire according to the tests in the standard, among others:<br>- electrical safety tests<br>- mechanical tests<br>- environmental tests                                       | IEC/EN 60155*, 60238*, 60400*, 60570*, 60598*, 60838*, 60921*, 60968*, 60969*, 61347*, 62471*<br>IEC/EN 60929, 61184, 62031, 62035, 60923, 60925, 60927, 61047, 62384, 62560, 61195, 62493 | * see note 3 |
| 6   | Measurement, control and laboratory equipment (MEAS) | Type test of measurement-, control- and laboratory equipment according to the tests in the standard, among others:<br>- electrical safety tests<br>- mechanical tests<br>- environmental tests | IEC/EN 61010*<br>IEC/EN 60044<br><br>IEC/EN 61243<br>IEEE Std C57.13   | * see note 3 |
| 7   | Electrical equipment for medical use (MED)           | Type test of electrical equipment for medical use according to the tests in the standard, among others:<br>- electrical safety tests<br>- mechanical tests<br>- environmental tests            | IEC/EN 60601*<br>IEC/EN/ISO 80601<br>HD 395  | * see note 3 |
| 8   | Miscellaneous equipment (MISC)                       | Type test of miscellaneous equipment according to the tests in the standard, among others:<br>- electrical safety tests<br>- mechanical tests<br>- environmental tests                         | IEC/EN 60825*  | * see note 3 |

**ВЯРНО С  
ОРИГИНАЛА**



Annex to ISO/IEC 17025:2005 declaration of accreditation for registration number: **L 022**

of **DEKRA Certification B.V.**

This annex is valid from: **29-04-2015 to 01-03-2018**

Replaces annex dated: **03-11-2014**

| No. | Material or product   | Type of activity   | Reference number  | Remarks      |
|-----|---|--|---|--------------|
| 9   | IT and office equipment<br><b>(OFF)</b>                     | Type test of IT and office equipment according to the tests in the standard, among others:<br><ul style="list-style-type: none"> <li>- electrical safety tests</li> <li>- mechanical tests</li> <li>- environmental tests</li> </ul>                     | IEC/EN 60950*<br>IEC/EN 62040*<br>IEC/EN 60825<br>IEC 62368<br>EN 41003   | * see note 3 |
| 10  | Low voltage, high power switching equipment<br><b>(POW)</b> | Type test of low voltage, high power switching equipment according to the tests in the standard, among others:<br><ul style="list-style-type: none"> <li>- electrical safety tests</li> <li>- mechanical tests</li> <li>- environmental tests</li> </ul> | IEC/EN 60439*, 61439,<br>IEC/EN 60947*<br>IEC/EN 60282, 62208<br>EN 50178, IEC 60470, 60549,<br>60644, EN 60282-1<br>IEEE Std C37.41, C37.60<br>ANSI C37.44<br>IEC 61921  | * see note 3 |
| 11  | Installation protective equipment<br><b>(PROT)</b>          | Type test of installation protective equipment according to the tests in the standard, among others:<br><ul style="list-style-type: none"> <li>- electrical safety tests</li> <li>- mechanical tests</li> <li>- environmental tests</li> </ul>           | IEC/EN 60127*, 60269*, 60529*,<br>60898*, 61008*, 61009*, 61643*,<br>60755, 62019<br>IEC 60099, 60137, 60168,<br>60383, 60507, 60660, 61109,<br>60815<br>HD 630, 639, 60269<br>IEEE Std 62.11<br>ANSI C29<br>CAN/CSA C411.1 | * see note 3 |
| 12  | Safety transformers and similar equipment<br><b>(SAFE)</b>  | Type test of safety transformers and similar equipment according to the tests in the standard, among others:<br><ul style="list-style-type: none"> <li>- electrical safety tests</li> <li>- mechanical tests</li> <li>- environmental tests</li> </ul>   | IEC/EN 60044*, IEC/EN 61558*<br>IEC/EN 62040,<br>IEC/EN 60076, IEC/EN 60253<br>EN 50091, EN 50464-1<br>HD 538.1<br>IEEE Std. C57.12.90, C57.21<br>NEMA 107<br>CISPR 16  | * see note 3 |



Annex to ISO/IEC 17025:2005 declaration of accreditation for registration number: **L 022**

of **DEKRA Certification B.V.**



This annex is valid from: **29-04-2015 to 01-03-2018**

Replaces annex dated: **03-11-2014**

| No. | Material or product  | Type of activity   | Reference number   | Remarks      |
|-----|--|--|--|--------------|
| 13  | Electric tools<br><b>(TOOL)</b>  | Type test of electric tools according to the tests in the standard, among others:<br><br>- electrical safety tests<br><br>- mechanical tests<br><br>- environmental tests  | IEC/EN 60745*<br>IEC/EN 61029*<br>IEC/EN 60335* (Gardening)<br>IEC/EN 62233, IEC/EN 60204<br>EN 50144<br>EN 50260-2-7<br>EN 792<br>EN/ISO 1114<br>IEC/EN 62061<br>EN/ISO 13849-1   | * see note 3 |
| 14  | Electronics, entertainment equipment<br><b>(TRON)</b>                      | Type test according to the tests as mentioned in the standard, except the following tests which are subcontracted:<br><br>60065, cl. 20.1.3 Pre-conditioning of printed circuit boards<br>60065, cl. 12.1.2 Vibration-sine | IEC / EN 60065*<br>IEC / EN 60491<br>IEC 62368   | * see note 3 |
| 15  | Products within the scope of the EMC Directive 2004/108/EC<br><b>(EMC)</b> | Type test according to the tests as mentioned in the standard  | CISPR11; CISPR12; CISPR13;<br>CISPR14-*; CISPR15;<br>CISPR16-*-*; CISPR20;<br>CISPR22; CISPR24; CISPR25;<br>IEC60601-*-*; IEC60945;<br>IEC60947-*-*; IEC61000-*-*;<br>IEC61008-1; IEC61009-1;<br>IEC61131-2; IEC61204-3;<br>IEC61326-*; IEC61543;<br>IEC61547; IEC61800-*;<br>IEC62040-2; IEC62052-*;<br>IEC62053-*; IEC62054-*; | * see note 3 |

**B. Electromagnetic Compatibility (EMC): Automotive tests**

|   |   |   |  |      |
|---|---|---|--|------|
| 1 | Vehicles, Motorcycles, Motorboats and Spark-ignited engine-driven devices | Radiated emission<br>30 to 1000 MHz OATS              | European Directives<br>2004/104/EC, 97/24/EC<br><br>European regulation ECE-R10.04<br><br>EN 55012, CISPR 12 | <br> |
| 2 | Vehicles, Motorcycles, Motorboats and Spark-ignited engine-driven devices | Radiated immunity up to 30 V/m<br>20 to 2000 MHz OATS | European Directive<br>2004/104, 97/24/EC<br><br>European regulation ECE-R10.04                               |      |

Annex to ISO/IEC 17025:2005 declaration of accreditation for registration number: **L 022**

of **DEKRA Certification B.V.**

This annex is valid from: **29-04-2015** to **01-03-2018**


Replaces annex dated: **03-11-2014**

| No. | Material or product                       | Type of activity  | Reference number   | Remarks |
|-----|---|---|--|---------|
| 3   | Electrical/<br>electronic<br>sub-assembly | Pulse emission for ESA's<br>along supply lines 12V and 24V  | European Directive 2004/104/EC<br>European regulation ECE-R10.04<br>ISO 7637-1<br>ISO 7637-2                 |         |
| 4   |   | Conducted emission for ESA's<br>(V-method, LISN)<br>150 kHz to 108 MHz                                  | European Directive 2004/104/EC<br>European regulation ECE-R10.04<br>CISPR25                                  |         |
| 5   |   | Radiated emission for ESA's<br>Anechoic Chamber method<br>30 to 1000 MHz                                | European Directive 2004/104/EC<br>European regulation ECE-R10.04<br>CISPR25                                  |         |
| 6   |   | Radiated immunity for ESA's<br>Anechoic Chamber method and<br>GTEM method<br>20 to 2000 MHz up to 30V/m | European Directive 2004/104/EC<br>European regulation ECE-R10.04<br>ISO 11452-1, ISO 11452-2,<br>ISO 11452-3 |         |
| 7   | Electrical/<br>electronic<br>sub-assembly | Bulk Current Injection for ESA's<br>20 to 400 MHz<br>up to 100 mA                                       | European Directive 2004/104/EC<br>European regulation ECE-R10.04<br>ISO 11452-1, ISO 11452-4                 |         |
| 8   |   | Pulse immunity for ESA's<br>along supply lines 12V and 24V  | European Directive 2004/104/EC<br>European regulation ECE-R10.04<br>ISO 7637-1<br>ISO 7637-2                 |         |

ВЪРНО С  
ОРИГИНАЛА

**C. Electromagnetic Compatibility (EMC): EMF tests**

|   |  |                                |                      |  |
|---|--|--------------------------------|----------------------|--|
| 1 | Electrical and electronic<br>equipment | EMF measurements:<br>0-400 kHz | EN 62233<br>EN 62493 |  |
|---|--|--------------------------------|----------------------|--|



Annex to ISO/IEC 17025:2005 declaration of accreditation for registration number: **L 022**

of **DEKRA Certification B.V.**



This annex is valid from: **29-04-2015** to **01-03-2018**

Replaces annex dated: **03-11-2014**

| No. | Material or product | Type of activity | Reference number | Remarks |
|-----|---------------------|------------------|------------------|---------|
|-----|---------------------|------------------|------------------|---------|

**D. Electromagnetic Compatibility (EMC): Emission tests**

|   |                                     |  |  |  |
|---|-------------------------------------|--|--|--|
| 1 | Electrical and electronic equipment | Conducted emission<br>9 kHz to 30 MHz                                  | EN 55011, CISPR 11<br>EN 55013, CISPR 13<br>EN 55014-1, CISPR 14-1<br>EN 55015, CISPR 15<br>EN 55022, CISPR 22 |  |
| 2 |                                     | Radiated Emission Electric (EM) Field<br>30 MHz to 18 GHz              | EN 55011, CISPR 11<br>EN 55014-1, CISPR 14-1<br>EN 55022, CISPR 22   |  |
| 3 |                                     | Disturbance power<br>30 MHz to 300 MHz                                 | EN 55014-1, CISPR 14-1   |  |
| 4 |                                     | Click disturbances<br>150 kHz to 30 MHz                                | EN 55011, CISPR 11<br>EN 55014-1, CISPR 14-1   |  |
| 5 |                                     | Radiated Emission Magnetic Field<br>9 kHz to 30 MHz                    | EN 55011, CISPR 11<br>EN 55015, CISPR 15   |  |
| 6 |                                     | Harmonic current emissions<br>0 Hz to 2 kHz<br>up to 16 A per phase    | IEC / EN 61000-3-2   |  |
| 7 |                                     | Pulse magnetic field immunity<br>up to 1000 A/m                        | IEC/EN 61000-4-9   |  |
| 8 |                                     | Limitation of voltage fluctuations and<br>flicker up to 16 A per phase | IEC / EN 61000-3-3   |  |


**E. Electromagnetic Compatibility (EMC): FCC tests (USA legislation)**

|   |   |                            |   |  |
|---|---|----------------------------|---|--|
| 1 | Radio-Frequency Devices<br>Industrial, Scientific and Medical Equipment | Emission<br>9 kHz to 3 GHz | 47 CFR FCC Part 15, Part 18<br>ANSI C63.4<br>FCC MP-5 |  |
|---|---|----------------------------|---|--|

**ВЯРНО С  
ОРМЪТНА**

**F. Electromagnetic Compatibility (EMC): Immunity test**

|   |                                   |   |                  |  |
|---|-----------------------------------|---|------------------|--|
| 1 | Electric and electronic equipment | Electrostatic discharge immunity<br>up to 30 kV             | IEC/EN 61000-4-2 |  |
| 2 |                                   | Radiated EM field immunity<br>up to 2,5 GHz<br>up to 30 V/m | IEC/EN 61000-4-3 |  |
| 3 |                                   | EFT Burst immunity<br>up to 4 kV                            | IEC/EN 61000-4-4 |  |



*Handwritten signature*

Annex to ISO/IEC 17025:2005 declaration of accreditation for registration number: **L 022**

of **DEKRA Certification B.V.**



This annex is valid from: **29-04-2015** to **01-03-2018**

Replaces annex dated: **03-11-2014**

| No. | Material or product               | Type of activity   | Reference number  | Remarks |
|-----|-----------------------------------|--|-------------------|---------|
| 4   | Electric and electronic equipment | Surge immunity up to 10 kV   | IEC/EN 61000-4-5  |         |
| 5   |                                   | Immunity to conducted RF disturbances up to 230 MHz, up to 30 Vrms | IEC/EN 61000-4-6  |         |
| 6   |                                   | Power frequency magnetic field immunity up to 100 A/m              | IEC/EN 61000-4-8  |         |
| 7   |                                   | Voltage dips and interruptions Single phase equipment up to 16 A   | IEC/EN 61000-4-11 |         |
| 8   |                                   | Ring wave immunity test  | IEC/EN 61000-4-12 |         |

**G. Electromagnetic Compatibility (EMC): MISC**


|   |  |  |                  |  |
|---|--|--|------------------|--|
| 1 | Railway applications - Electromagnetic compatibility | Electromagnetic compatibility testing according the listed product standards | EN 50121-1 to -5 |  |
| 2 | Road traffic signal systems                          | Electromagnetic compatibility testing according the listed product standard  | EN 50293         |  |

**H. Photometric Tests**

(all tests are in accordance with the reference method)

|   |  |  |   |               |
|---|--|--|---|---------------|
| 1 | Headlamps low and high beams and front fog lamps         | All tests as mentioned in the ECE Regulations stated under Test method<br>Photometry<br>Colorimetry<br>Heat tests<br>Plastic tests | ECE Regulations Nos. 1, 5, 8, 19, 20, 31, 56, 57, 72, 76, 82, 98, 112, 113 and 123;<br>European Directives 76/761, 76/762 and 97/24   | <b>Note 1</b> |
| 2 | Signalling lamps   | All tests as mentioned in the ECE Regulations stated under Test method<br>Photometry<br>Colorimetry<br>Heat test                   | ECE Regulations Nos. 6, 7, 23, 38, 50, 77, 87 and 91 and<br>European Directives 76/757, 76/759, 76/758, 77/538, 77/539, 77/540 and 97/24<br>ECE Regulation 38 (rear fog lamps only) |               |
| 3 | Devices for the illumination of rear registration plates | All tests as mentioned in the ECE Regulations stated under Test method<br>Luminance  | ECE Regulations Nos. 4 and 50<br>European Directives 76/760 and 97/24   |               |

**ВЯРНО С ОПРИИНАЛА**



*Handwritten signature*

Annex to ISO/IEC 17025:2005 declaration of accreditation for registration number: **L 022**


of **DEKRA Certification B.V.**

This annex is valid from: **29-04-2015** to **01-03-2018**

Replaces annex dated: **03-11-2014**

| No. | Material or product                              | Type of activity   | Reference number  | Remarks               |
|-----|--|--|---|-----------------------|
| 4   | Retro-reflective devices                         | All tests as mentioned in the ECE Regulations stated under Test method<br><br>Retro-reflection<br>Colorimetry<br>Water resistance test<br>Corrosion<br>Fuel and oil resistance<br>Heat test<br>UV resistance | ECE Regulations Nos. 3, 27, 69, 70, 88 and 104<br>European Directive 76/757         | <b>Note 2</b><br><br> |
| 5   | Light Sources                                    | All tests as mentioned in the ECE Regulations stated under Test method<br><br>Geometry<br>Photometry<br>Colorimetry<br>Optical quality<br>Mechanical tests   | ECE Regulations Nos. 37, 99<br>IEC 60809<br>IEC 60810<br>IEC 60983<br><br>IEC 60061 |                       |
| 6   | Special warning lamps (beacons and flash lights) | All tests as mentioned in the ECE Regulations stated under Test method<br><br>Photometry<br>Colorimetry<br>Water resistance test   | ECE Regulation No. 65   |                       |
| 7   | Cornering Lamps                                  | All tests as mentioned in the ECE Regulation stated under Test method<br><br>Photometry<br>Colorimetry   | ECE Regulation No.119   |                       |

**ВЯРНО С  
ОРИГИНАЛА**





Annex to ISO/IEC 17025:2005 declaration of accreditation for registration number: **L 022**

of **DEKRA Certification B.V.**

This annex is valid from: **29-04-2015 to 01-03-2018**

Replaces annex dated: **03-11-2014**

| No.   | Material or product                    | Type of activity   | Reference number      | Remarks |
|---|--|--|-----------------------|---------|
| <b>I. Lighting testing: EPA ENERGY STAR Program</b> |  |  |                       |         |
| 1   | Non-directional Fluorescent Luminaires | Specifications for Performance of Self-Ballasted Compact Fluorescent Lamps, Source Run-up Time (ms)                                    | ANSI C78.5:2003       |         |
|   |  | Method of Measurement of Fluorescent Lamp Ballasts, Power Factor, Operating Frequency  | ANSI C82.2:2002       |         |
|   |  | Method of Measuring and Specifying Color Rendering of Light Sources, Color Rendering (CRI)   | CIE Pub. No.13.3:1995 |         |
|   |  | Colorimetry, CCT   | CIE Pub No. 15:2004   |         |
|   |  | Electric and Photometric Measurements of Fluorescent Lamps, Efficacy, Light Output, Lumen Maintenance, CCT, CRI                        | IES LM-9:2009         |         |
|   |  | Life Testing of Fluorescent Lamps, Light Source Life, Lumen Maintenance  | IES LM-40:2010        |         |
|   |  | Life Testing of Compact Fluorescent Lamps, Light Source Life, Lumen Maintenance  | IES LM-65:2010        |         |
|   |  | Electrical and Photometric Measurements of Single-Ended Compact Fluorescent Lamps, Efficacy, Light Output, Lumen Maintenance, CCT, CRI | IES LM-66:2011        |         |

**ВЯРНО С  
ОРИГИНАЛА**


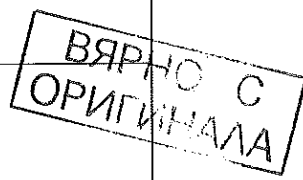



Annex to ISO/IEC 17025:2005 declaration of accreditation for registration number: **L 022**

of **DEKRA Certification B.V.**

This annex is valid from: **29-04-2015** to **01-03-2018**

Replaces annex dated: **03-11-2014**


| No. | Material or product  | Type of activity   | Reference number      | Remarks  |
|-----|--|--|-----------------------|--|
| 2   | Directional Fluorescent Luminaires   | Specifications for Performance of Self-Ballasted Compact Fluorescent Lamps, Source Run-up Time (ms)                                    | ANSI C78.5:2003       |    |
|     |  | Method of Measurement of Fluorescent Lamp Ballasts, Power Factor, Operating Frequency  | ANSI C82.2:2002       |  |
|     |  | Method of Measuring and Specifying Color Rendering of Light Sources, Color Rendering (CRI)   | CIE Pub. No.13.3:1995 |  |
|     |  | Colorimetry, CCT   | CIE Pub No. 15:2004   |  |
|     |  | Electric and Photometric Measurements of Fluorescent Lamps, Efficacy, Light Output, Lumen Maintenance, CCT, CRI                        | IES LM-9:2009         |  |
|     |  | Life Testing of Fluorescent Lamps, Light Source Life, Lumen Maintenance  | IES LM-40:2010        |  |
|     |  | Life Testing of Compact Fluorescent Lamps, Light Source Life, Lumen Maintenance  | IES LM-65:2010        |  |
|     |  | Electrical and Photometric Measurements of Single-Ended Compact Fluorescent Lamps, Efficacy, Light Output, Lumen Maintenance, CCT, CRI | IES LM-66:2011        |  |
|     |  | Photometric Testing of Outdoor Fluorescent Luminaires, Efficacy, Light Output, Zonal Lumen Distribution                                | IES LM-10:2013        |  |
|     | Approved Method for Photometric Testing of Indoor Fluorescent Luminaries, Efficacy, Light Output, Zonal Lumen Distribution | IES LM-41:2013   |                       |  |
| 3   | Luminaires CSD - Fluorescent Ballasts  | Method of Measurement of Fluorescent Lamp Ballasts, Power Factor, Operating Frequency  | ANSI C82.2:2002       | <br> |

Annex to ISO/IEC 17025:2005 declaration of accreditation for registration number: **L 022**


of **DEKRA Certification B.V.**

This annex is valid from: **29-04-2015** to **01-03-2018**

Replaces annex dated: **03-11-2014**
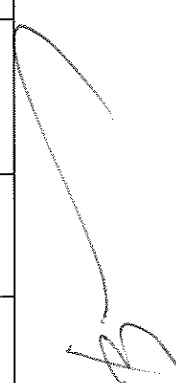
| No. | Material or product                | Type of activity   | Reference number          | Remarks  |
|-----|------------------------------------|--|---------------------------|--|
| 4   | Luminaires CSD - Fluorescent Lamps | Method of Measuring and Specifying Color Rendering of Light Sources, Color Rendering   | CIE Pub. No.13.3:1995     |  |
|     |                                    | Colorimetry, CCT   | CIE Pub No. 15:2004       |  |
|     |                                    | Electric and Photometric Measurements of Fluorescent Lamps, Efficacy, Light Output, Lumen Maintenance, CCT, CRI                        | IES LM-9:2009             |  |
|     |                                    | Life Testing of Fluorescent Lamps, Light Source Life, Lumen Maintenance  | IES LM-40:2010            |  |
|     |                                    | Life Testing of Compact Fluorescent Lamps, Light Source Life, Lumen Maintenance  | IES LM-65:2010            |  |
|     |                                    | Electrical and Photometric Measurements of Single-Ended Compact Fluorescent Lamps, Efficacy, Light Output, Lumen Maintenance, CCT, CRI | IES LM-66:2011            |  |
| 5   | Non-Directional HID Luminaires     | High-Intensity Discharge (HID)— Methods of Measuring Characteristics, Operating Frequency  | ANSI C78.389:2004 (R2009) |  |
|     |                                    | Ballasts for High Intensity Discharge (HID) Lamps - Methods of Measurement, Power Factor, Lamp Current Crest Factor                    | ANSI C82.6:2005           |  |
|     |                                    | Method of Measuring and Specifying Color Rendering of Light Sources, Color Rendering   | CIE Pub. No.13.3:1995     |  |
|     |                                    | Life Testing of High Intensity Discharge (HID) Lamps, Light Source Life, Lumen Maintenance   | IES LM-47:2012            |  |
|     |                                    | Electrical and Photometric Measurements of High Intensity Discharge Lamps, Efficacy, Light Output, CCT, CRI                            | IES LM-51:2013            |  |

ВЯРНО С  
ОРИГИНАЛ





Annex to ISO/IEC 17025:2005 declaration of accreditation for registration number: **L 022**

of **DEKRA Certification B.V.**

This annex is valid from: **29-04-2015** to **01-03-2018**

Replaces annex dated: **03-11-2014**

| No. | Material or product           | Type of activity   | Reference number             | Remarks   |
|-----|-------------------------------|--|------------------------------|---|
| 6   | Directional HID Luminaires    | High-Intensity Discharge (HID)—<br>Methods of Measuring<br>Characteristics, Operating Frequency  | ANSI C78.389:2004<br>(R2009) |   |
|     |                               | Ballasts for High Intensity Discharge (HID) Lamps - Methods of Measurement, Power Factor, Lamp Current Crest Factor  | ANSI C82.6:2005              |   |
|     |                               | Method of Measuring and Specifying Color Rendering of Light Sources, Color Rendering   | CIE Pub. No.13.3:1995        |   |
|     |                               | Life Testing of High Intensity Discharge (HID) Lamps, Light Source Life, Lumen Maintenance   | IES LM-47:2012               |   |
|     |                               | Electrical and Photometric Measurements of High Intensity Discharge Lamps, Efficacy, Light Output, CCT, CRI  | IES LM-51:2013               |   |
|     |                               | Photometric Testing of Roadway Luminaires Using Incandescent Filament and High Intensity Discharge (HID) Lamps, Efficacy, Output, Zonal Lumen Distribution | IES LM-31:2013               |   |
|     |                               | Photometric Testing of Indoor Luminaires Using High Intensity Discharge or Incandescent Filament Lamps, Efficacy, Light Output, Zonal Lumen Distribution   | IES LM-46:2004               |   |
| 7   | Luminaires CSD - HID Ballasts | High-Intensity Discharge (HID)—<br>Methods of Measuring<br>Characteristics, Operating Frequency  | ANSI C78.389:2004<br>(R2009) |  |
|     |                               | High-Intensity Discharge (HID)—<br>Methods of Measuring<br>Characteristics, Operating Frequency  | ANSI C78.389:2004<br>(R2009) |   |
|     |                               | Ballasts for High Intensity Discharge (HID) Lamps - Methods of Measurement, Power Factor, Lamp Current Crest Factor  | ANSI C82.6:2005              |   |

Annex to ISO/IEC 17025:2005 declaration of accreditation for registration number: **L 022**

of **DEKRA Certification B.V.**

This annex is valid from: **29-04-2015** to **01-03-2018**

Replaces annex dated: **03-11-2014**

| No. | Material or product                                      | Type of activity  | Reference number                  | Remarks |
|-----|--|---|-----------------------------------|---------|
| 8   | Luminaires CSD - HID Lamps                               | Method of Measuring and Specifying Color Rendering of Light Sources, Color Rendering  | CIE Pub. No.13.3:1995             |         |
|     |  | Life Testing of High Intensity Discharge (HID) Lamps, Light Source Life, Lumen Maintenance  | IES LM-47:2012                    |         |
|     |  | Electrical and Photometric Measurements of High Intensity Discharge Lamps, Efficacy, Light Output, CCT, CRI   | IES LM-51:2013                    |         |
| 9   | Non-directional Solid State Luminaires and Subcomponents | Electrical and Photometric Measurements of Solid-State Lighting Products (section 10 not required for non-directional or subcomponents), Efficacy, Output, Lumen Maintenance, CCT, CRI, Color Maintenance             | IES LM-79:2008                    |         |
|     |  | Harmonic Emission Limits—Related Power Quality Requirements for Lighting Equipment, Power Factor  | ANSI C82.77:2002                  |         |
|     |  | Method of Measuring and Specifying Color Rendering of Light Sources, CRI  | CIE Pub. No.13.3:1995             |         |
|     |  | Colorimetry, CCT  | CIE Pub No. 15:2004               |         |
|     |  | Characterization of LED Light Engines and LED Lamps for Electrical and Photometric Properties as a Function of Temperature, Efficacy, Light Output, Lumen Maintenance, CCT, CRI, Color Maintenance, Light Source Life | IES LM-82:2012                    |         |
| 10  | Directional Solid State Luminaires                       | Electrical and Photometric Measurements of Solid-State Lighting Products (Goniophotometer), Zonal Lumen Distribution, Color Angular Uniformity, Luminaire Photometry  | IES LM-79:2008 sections 10 and 12 | <br>    |
|     |  | Guide to Spectroradiometric Measurements, Color Angular Uniformity  | IES LM-58:2013                    |         |

Annex to ISO/IEC 17025:2005 declaration of accreditation for registration number: **L 022**


of **DEKRA Certification B.V.**

This annex is valid from: **29-04-2015** to **01-03-2018**

Replaces annex dated: **03-11-2014**

| No. | Material or product                                    | Type of activity   | Reference number                  | Remarks |
|-----|--|--|-----------------------------------|---------|
| 10  | Directional Solid State Luminaires                     | Method of Measuring and Specifying Color Rendering of Light Sources, CRI   | CIE Pub. No.13.3:1995             |         |
|     |  | Colorimetry, CCT   | CIE Pub No. 15:2004               |         |
|     |  | Electrical and Photometric Measurements of Solid-State Lighting Products, Efficacy, Light Output, Lumen Maintenance, CCT, CRI, Color Maintenance | IES LM-79:2008                    |         |
| 11  | Lumen Maintenance of LED Packages, Arrays, and Modules | Method for Measuring Lumen Maintenance of LED Light Sources, Light Source Life, Lumen Maintenance  | IES LM-80:2008                    |         |
| 12  | Non-Directional Outdoor Halogen Luminaires             | Approved Method for Life Testing of Filament Lamps, Light Source Life Requirements   | IES LM-49:2001,<br>IES LM-49:2011 |         |
| 13  | Directional Outdoor Halogen Luminaires                 | Approved Method for Life Testing of Filament Lamps, Light Source Life Requirements   | IES LM-49:2001                    |         |
|     |  | Photometric Testing of Outdoor Fluorescent Luminaires, Zonal Lumen Distribution  | IES LM-10:1996                    |         |
|     |  | Photometric Testing of Roadway Luminaires Using Incandescent Filament and High Intensity Discharge (HID) Lamps, Zonal Lumen Distribution         | IES LM-31:1991                    |         |
|     |  | Photometric Testing of Indoor Fluorescent Luminaires, Zonal Lumen Distribution   | IES LM-41:1998                    |         |
|     |  | Photometric Testing of Indoor Luminaires Using High Intensity Discharge or Incandescent Filament Lamps, Zonal Lumen Distribution                 | IES LM-46:2004                    |         |
|     |  | Electrical and Photometric Measurements of Solid-State Lighting Products, Zonal Lumen Distribution   | IES LM-79:2008 Section 10         |         |

ВЯРНО С  
ОРИГИНАЛ



Annex to ISO/IEC 17025:2005 declaration of accreditation for registration number: **L 022**


of **DEKRA Certification B.V.**

This annex is valid from: **29-04-2015** to **01-03-2018**

Replaces annex dated: **03-11-2014**

| No.  | Material or product  | Type of activity  | Reference number  | Remarks |
|--|--|---|---|---------|
| 14   | CFL Directional Lamps  | Electrical and Photometric Measurements of Single-Ended Compact Fluorescent Lamps, Efficacy, Light Output, Center beam Intensity, Lumen Maintenance, Lifetime, CCT, CRI | IES LM-66:2011  |         |
|  |  | Life Testing of Compact Fluorescent Lamps, Lumen Maintenance, Lifetime, Rapid Cycle Stress Test   | IES LM-65:2010  |         |
|  |  | IEEE Recommended Practice on Characterization of surges in Low Voltage (1000V and Less) AC Power Circuits, Transient Protection   | ANSI/IEEE C62.41.2-2002   |         |
|  |  | Fluorescent Lamp Ballasts, Method of Measurement of Power Factor (included supplements)   | ANSI C82.2:2002   |         |
|  |  | Specifications for the Chromaticity of Fluorescent lamps, CCT   | ANSI C78.376-2001   |         |
|  |  | Colorimetry, CCT  | CIE Pub No. 15:2004   |         |
|  |  | Method of Measuring and Specifying Color Rendering of Light Sources, Color Rendering (CRI)  | CIE Pub. No.13.3:1995   |         |
|  |  | Tool for Calculating Minimum Center beam Intensity, Minimum Center Beam Intensity – PAR and MR Lamps  | Energy Star Online CBCP Tool  |         |
|  |  | ENERGY STAR Program Requirements Product Specification for Lamps Version 1.0: Elevated Temperature Life Testing, Lumen Maintenance, Lifetime                            | ENERGY STAR Program Requirements Product Specification for Lamps Version 1.0: Elevated Temperature Life Testing       |         |
|  |  | ENERGY STAR Program Requirements Product Specification for Lamps Version 1.0: Elevated Temperature Life Testing, ETLOR  | ENERGY STAR Program Requirements Product Specification for Lamps Version 1.0: Elevated Temperature Light Output Ratio |         |
| ENERGY STAR Program Requirements Product Specification for Lamps Version 1.0: Start Time | ENERGY STAR Program Requirements Product Specification for Lamps Version 1.0: Start Time |   |   |         |

**ВЯРНО С КОПИЕ**



Annex to ISO/IEC 17025:2005 declaration of accreditation for registration number: **L 022**


of **DEKRA Certification B.V.**

This annex is valid from: **29-04-2015** to **01-03-2018**

Replaces annex dated: **03-11-2014**

| No.   | Material or product   | Type of activity  | Reference number  | Remarks |
|---|---|---|---|---------|
| 14  | CFL Directional Lamps   | ENERGY STAR Program Requirements Product Specification for Lamps Version 1.0: Run-up Time   | ENERGY STAR Program Requirements Product Specification for Lamps Version 1.0: Run-up Time                       |         |
| 15  | CFL Omnidirectional and Decorative Lamps  | Electrical and Photometric Measurements of Single-Ended Compact Fluorescent Lamps, Efficacy, Light Output, Center beam Intensity, Lumen Maintenance, Lifetime, CCT, CRI | IES LM-66:2011  |         |
|   |   | Life Testing of Compact Fluorescent Lamps, Lumen Maintenance, Lifetime, Rapid Cycle Stress Test   | IES LM-65:2010  |         |
|   |   | IEEE Recommended Practice on Characterization of surges in Low Voltage AC Power Circuits, Transient Protection  | ANSI/IEEE C62.41.2-2002   |         |
|   |   | Specifications for the Chromaticity of Fluorescent lamps, CCT   | ANSI C78.376-2001   |         |
|   |   | Method of Measurement of Fluorescent Lamp Ballasts, Power Factor  | ANSI C82.2:2002   |         |
|   |   | Colorimetry, CCT  | CIE Pub No. 15:2004   |         |
|   |   | Method of Measuring and Specifying Color Rendering of Light Sources, Color Rendering (CRI)  | CIE Pub. No.13.3:1995   |         |
|   |   | ENERGY STAR Program Requirements Product Specification for Lamps Version 1.0: Elevated Temperature Life Testing, Lumen Maintenance, Lifetime                            | ENERGY STAR Program Requirements Product Specification for Lamps Version 1.0: Elevated Temperature Life Testing |         |
|   |   | ENERGY STAR Program Requirements Product Specification for Lamps Version 1.0: Start Time  | ENERGY STAR Program Requirements Product Specification for Lamps Version 1.0: Start Time                        |         |
| ENERGY STAR Program Requirements Product Specification for Lamps Version 1.0: Run-up Time | ENERGY STAR Program Requirements Product Specification for Lamps Version 1.0: Run-up Time |   |   |         |

ВЯРНО С  
ОРИГИНАЛ






Annex to ISO/IEC 17025:2005 declaration of accreditation for registration number: **L 022**


of **DEKRA Certification B.V.**

This annex is valid from: **29-04-2015 to 01-03-2018**

Replaces annex dated: **03-11-2014**

| No.  | Material or product   | Type of activity   | Reference number  | Remarks  |
|--|---|--|---|--|
| 16   | LED Directional Lamps   | Electrical and Photometric Measurements of Solid-State Lighting Products, Efficacy, Output, Center Beam Intensity, Luminous Intensity Distribution, Lumen Maintenance, Lifetime, CCT, CRI, Color Maintenance, Color Angular Uniformity | IES LM-79:2008  |  |
|  |   | Harmonic Emission Limits—Related Power Quality Requirements for Lighting Equipment, Power Factor   | ANSI C82.77:2002 Sections 6 and 7   |  |
|  |   | IEEE Recommended Practice on Characterization of surges in Low Voltage AC Power Circuits, Transient Protection   | ANSI/IEEE C62.41.2-2002   |  |
|  |   | Colorimetry, CCT   | CIE Pub No. 15:2004   |  |
|  |   | Chromaticity of Solid State Lighting Products, CCT   | ANSI C78.377-2011   |  |
|  |   | Method of Measuring and Specifying Color Rendering of Light Sources, Color Rendering (CRI)   | CIE Pub. No.13.3:1995   |  |
|  |   | Tool for Calculating Minimum Center beam Intensity, Minimum Center Beam Intensity – PAR and MR Lamps   | Energy Star Online CBCP Tool  |  |
|  |   | ENERGY STAR Program Requirements Product Specification for Lamps Version 1.0: Elevated Temperature Life Testing, Lumen Maintenance, Lifetime   | ENERGY STAR Program Requirements Product Specification for Lamps Version 1.0: Elevated Temperature Life Testing |  |
|  |   | ENERGY STAR Program Requirements Product Specification for Lamps Version 1.0: Ambient Temperature Life Testing, Lumen Maintenance, Lifetime  | ENERGY STAR Program Requirements Product Specification for Lamps Version 1.0: Ambient Temperature Life Testing  |  |
| ENERGY STAR Program Requirements Product Specification for Lamps Version 1.0: Elevated Temperature Life Testing, ETLOR | ENERGY STAR Program Requirements Product Specification for Lamps Version 1.0: Elevated Temperature Light Output Ratio |  |   |  |

**ВЯРНО С ОПРИЧИНА**




Annex to ISO/IEC 17025:2005 declaration of accreditation for registration number: **L 022**


of **DEKRA Certification B.V.**

This annex is valid from: **29-04-2015** to **01-03-2018**

Replaces annex dated: **03-11-2014**

| No. | Material or product                      | Type of activity   | Reference number  | Remarks  |
|-----|--|--|---|--|
| 16  | LED Directional Lamps                    | ENERGY STAR Program Requirements Product Specification for Lamps Version 1.0: Start Time   | ENERGY STAR Program Requirements Product Specification for Lamps Version 1.0: Start Time                        |  |
| 17  | LED Omnidirectional and Decorative Lamps | Electrical and Photometric Measurements of Solid-State Lighting Products, Efficacy, Output, Center Beam Intensity, Luminous Intensity Distribution, Lumen Maintenance, Lifetime, CCT, CRI, Color Maintenance, Color Angular Uniformity | IES LM-79:2008  |  |
|     |  | Harmonic Emission Limits—Related Power Quality Requirements for Lighting Equipment, Power Factor   | ANSI C82.77:2002 Sections 6 and 7   |  |
|     |  | IEEE Recommended Practice on Characterization of surges in Low Voltage AC Power Circuits, Transient Protection   | ANSI/IEEE C62.41.2-2002   |  |
|     |  | Colorimetry, CCT   | CIE Pub No. 15:2004   |  |
|     |  | Method of Measuring and Specifying Color Rendering of Light Sources, Color Rendering (CRI)   | CIE Pub. No.13.3:1995   |  |
|     |  | ENERGY STAR Program Requirements Product Specification for Lamps Version 1.0: Elevated Temperature Life Testing, Lumen Maintenance, Lifetime   | ENERGY STAR Program Requirements Product Specification for Lamps Version 1.0: Elevated Temperature Life Testing |  |
|     |  | ENERGY STAR Program Requirements Product Specification for Lamps Version 1.0: Ambient Temperature Life Testing, Lumen Maintenance, Lifetime  | ENERGY STAR Program Requirements Product Specification for Lamps Version 1.0: Ambient Temperature Life Testing  |  |
|     |  | ENERGY STAR Program Requirements Product Specification for Lamps Version 1.0: Start Time   | ENERGY STAR Program Requirements Product Specification for Lamps Version 1.0: Start Time                        |  |

**ВЯРНО С  
ОРИГИНАЛА**



Annex to ISO/IEC 17025:2005 declaration of accreditation for registration number: **L 022**

of **DEKRA Certification B.V.**




This annex is valid from: **29-04-2015** to **01-03-2018**

Replaces annex dated: **03-11-2014**

| No.   | Material or product  | Type of activity   | Reference number   | Remarks |
|---|--|--|--|---------|
| <b>I. Additional Standards related to Energy Star</b> |  |  |  |         |
| 1   | Reflector type lamps                                       | Photometric Testing  | IES LM-35:2002   |         |
| 2   | Floodlights Using Incandescent Filament of Discharge Lamps | Electrical and photometric measurements  | IES LM-45:2009   |         |
| 3   | Fluorescent Lamps  | Electrical measurements  | ANSI C78.375:1997<br>ANSI C78.375:2014   |         |
| 4   | Fluorescent Lamps  | Chromaticity of Fluorescent Lamps  | ANSI C78.376-2001  |         |
| 5   | Fluorescent Lamps  | Chromaticity of Solid State Lighting Products  | ANSI C78.377-2011  |         |
| 6   | Mercury Lamps  | Measuring Characteristics  | ANSI C78.386:1989  |         |
| 7   | Metal-Halide Lamps   | Measuring Characteristics  | ANSI C78.387:1987  |         |
| 8   | High Pressure Sodium Lamps                                 | Measuring Characteristics  | ANSI C78.388:1990  |         |
| 9   | High-Frequency Fluorescent Lamp Ballast                    | Measurement of a High-Frequency Fluorescent Lamp Ballast   | ANSI C82.11-2002   |         |
| 10  | Light sources  | The measurement of luminous flux   | CIE 84:1989  |         |
| 11  | Luminaires   | The Photometry and goniophotometry of luminaires   | CIE121:1996  |         |
| 12  | All LED Products   | Measurements of LEDs   | CIE127:1997<br>CIE127:2007   |         |
| 13  | All products   | Transient protection   | ANSI/IEEE C62.41.1<br>ANSI/IEEE C62.41.2   |         |
| 14  | Decorative Light Strings                                   | Weathering Test  | ASTM G154-06<br>ASTM G154-12a  |         |
| 15  | Decorative Light Strings                                   | ENERGY STAR Test Method for Decorative Light Strings   | ENERGY STAR Test Method for Decorative Light Strings   |         |
| 16  | All products   | ENERGY STAR Program requirements Product Specification for Lamps Version 1.0: Final Test Methods and Recommended Practices | ENERGY STAR Program Requirements Product Specification for Lamps Version 1.0: Final Test Methods and Recommended Practices |         |

БЯРНО С  
ОП/ЕЛЕНА



*Handwritten signature or mark at the bottom of the page.*

Annex to ISO/IEC 17025:2005 declaration of accreditation for registration number: **L 022**

of **DEKRA Certification B.V.**

This annex is valid from: **29-04-2015** to **01-03-2018**

Replaces annex dated: **03-11-2014**



Note 1: Weather-beaten tests of synthetic lenses is subcontracted

Note 2: Salt-nebula test is subcontracted

Note 3: See current list of sub set of standards on the IECEE CBTL website

ВЯРВАЩА  
ОРИГИНАЛ




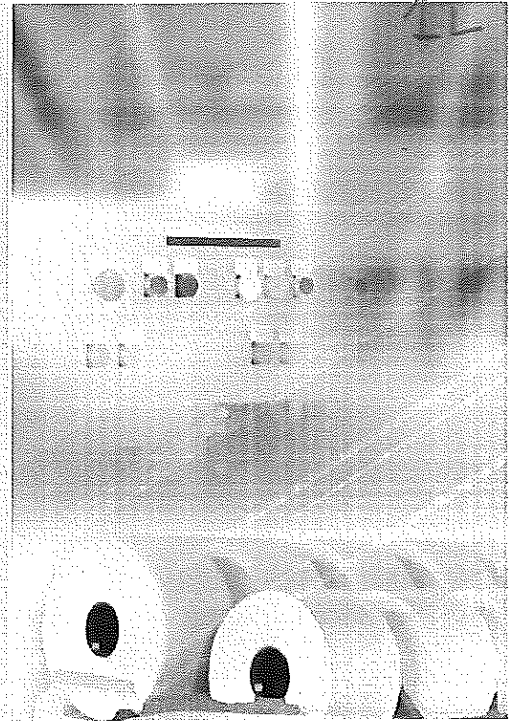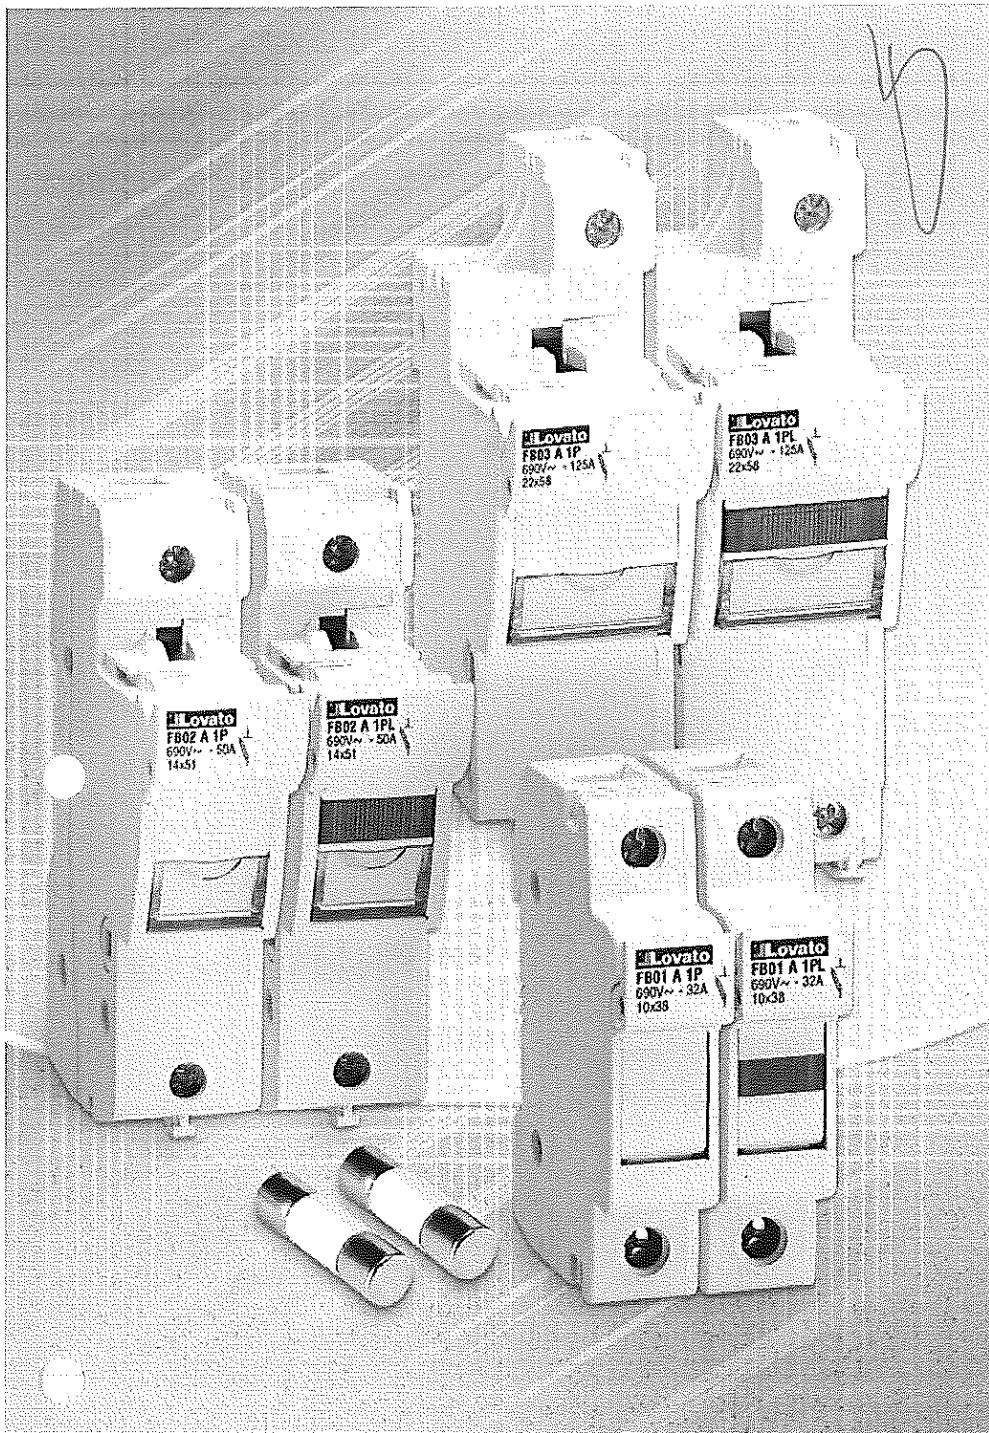

## Fuse holders and fuses


ВЯРНО С  
ОРИГИНАЛА

**Lovato**  
**electric**  
100% electricity



*my*


# Fuse holders

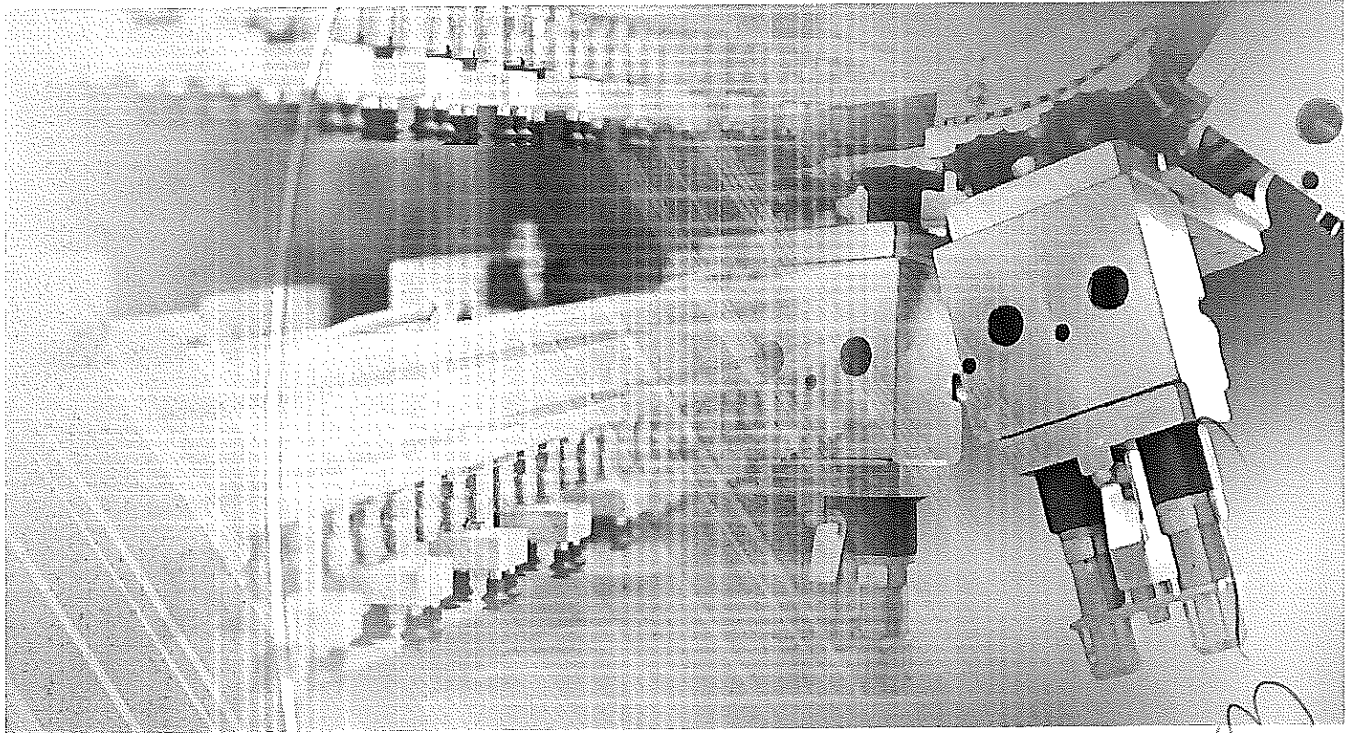

- ◆ Modular concept for quick assembly of different versions based on various requirements.
- ◆ Compact size compliant with standards for electrical equipment.
- ◆ DIN rail mounting and removal ease.
- ◆ IP20 protection degree, finger safe.
- ◆ Sealable cover in open or closed position to increase user's safety.
- ◆ Version with status indicator to quickly determine if the fuse is still operative or needs to be replaced.
- ◆ Ergonomic grip for easy cover opening.
- ◆ Dedicated cylindrical 10x38 DC fuses for photovoltaic systems.
- ◆ UL and CSA certified versions.





| Range                | AC                         |       |       | DC                            | DC FUSES       | CLASS CC                   |
|----------------------|----------------------------|-------|-------|-------------------------------|----------------|----------------------------|
| Fuse size            | 10x38                      | 14x51 | 22x58 | 10x38                         | 10x38          | 10x38                      |
| Type                 | gG or aM                   |       |       | gPV                           | gPV            | Class CC                   |
| Rated voltage        | 690VAC                     |       |       | 1000VDC / 690VAC              | 1000VDC        | 600VAC                     |
| Rated current        | 32A                        | 50A   | 125A  | 32A                           | 20A            | 30A                        |
| Utilisation category | AC-22B 500V<br>AC-21B 690V |       | -     | DC-20B 1000VDC<br>AC-21B 690V | DC-20B 1000VDC | AC-22B 500V<br>AC-21B 690V |

ВЯРНО  
ОРИГИН

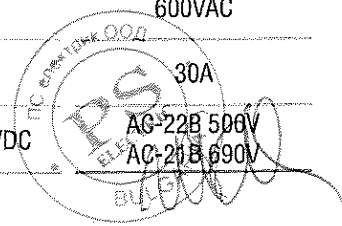

*Handwritten signature or mark at the bottom of the page.*

# and fuses

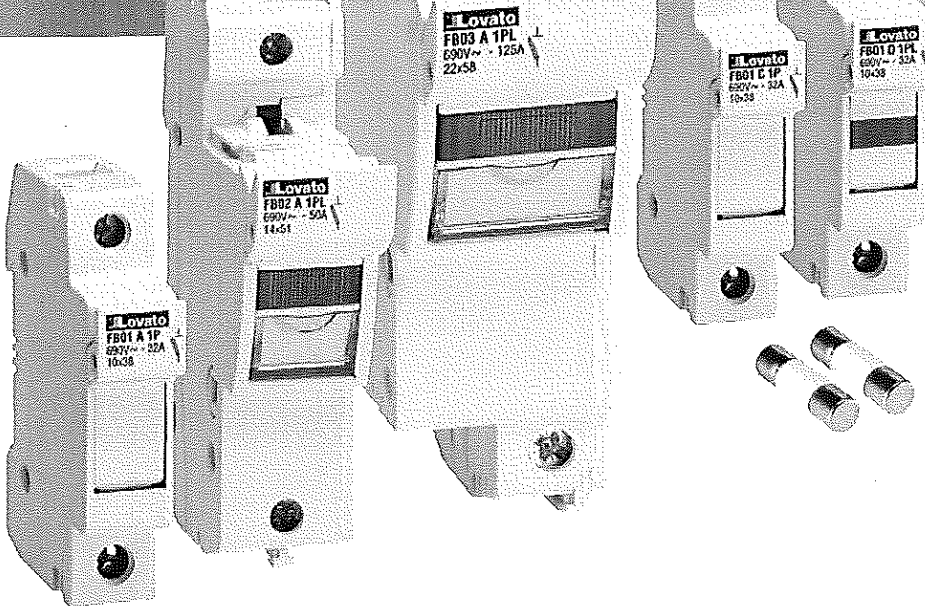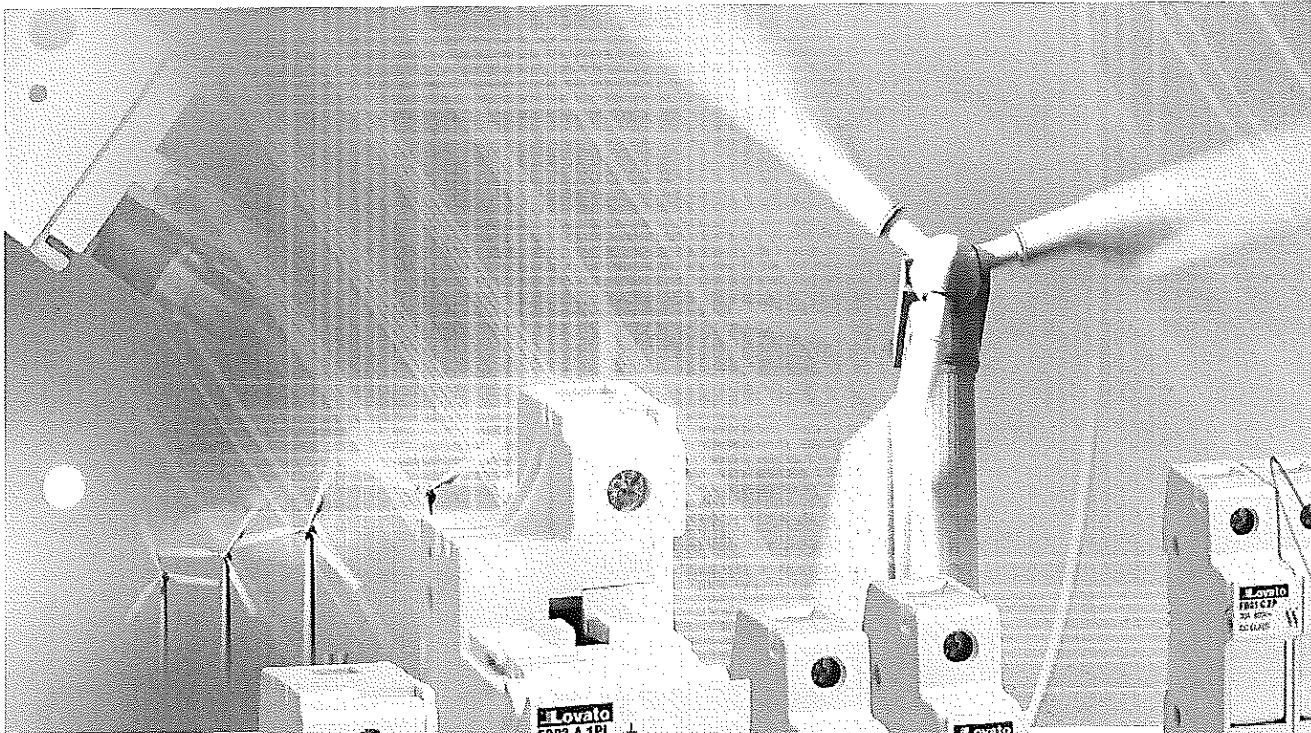


ВЯРНО С  
ОРИГИНАЛА

LOVATO Electric fuse holders can be used to protect against overloads and short circuits of electric lines, for motor protection and control and for the protection of electric installations.


This equipment can assure the disconnect function but is not suitable for isolation so cannot be used as switch disconnector.

The range is available in two versions: with or without fuse status indicator. If the fuse fitted on the holder blows, the failure status is shown by the indicator on the fuse-holder front.

All the fuse holders are certified for the North-American market (UL Listed, UL Recognized and CSA). Furthermore, there is a non-certified version in 10x38mm size available too.

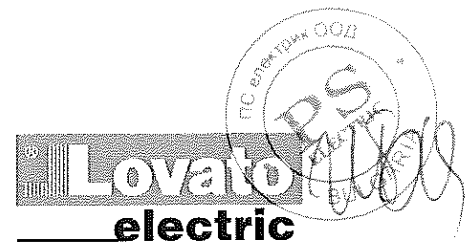

*Handwritten signature*

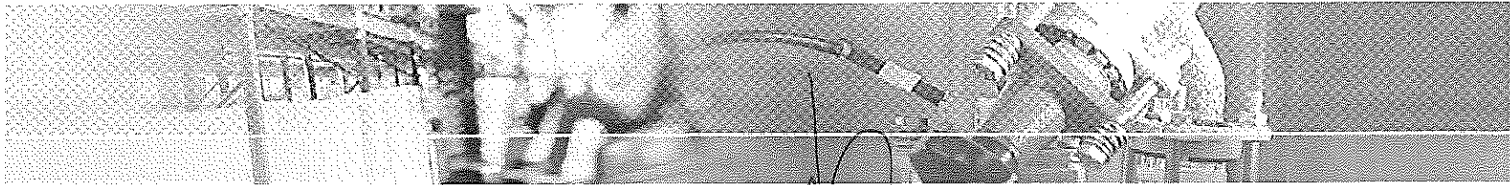


# Fuse holders **AC** RANGE

LOVATO Electric AC fuse-holder range is suitable for class gG fuses, to protect cables and conductors, and for class aM fuses, to protect motor starting.


Function: Overload and short-circuit protection of control circuits, motor controls, electric installations.

Usage: Service industry, electric panels onboard machinery, electric installations in general.

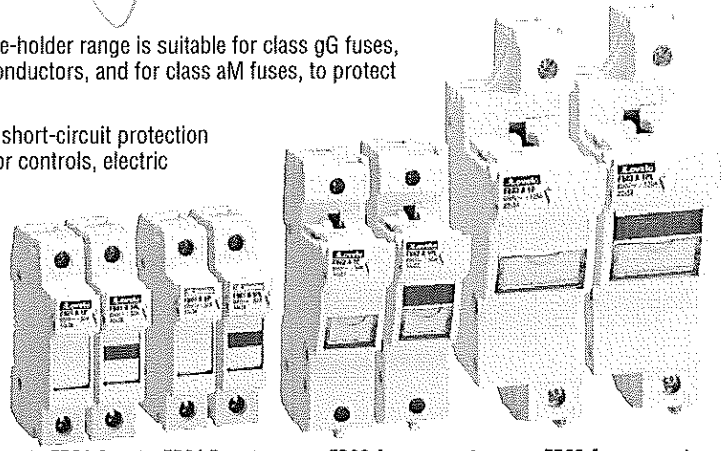


| Fuse size                         | FB01 A...<br>10x38   | FB01 B... | FB02 A...<br>14x51  | FB03 A...<br>22x58  |
|-----------------------------------|--|-----------|---|---|
| Version without indicator         | 1P, 1P+N, 2P, 3P, 3P+N   |           | 1P  |   |
| Version with indicator            | 1P   |           |   |   |
| <b>Main characteristics</b>       |  |           |   |   |
| - Rated voltage                   | 690VAC   |           |   |   |
| - Rated current                   | 32A  |           | 50A   | 125A  |
| - Utilisation category            | AC-22B 500V,<br>AC-21B 690V  |           | AC-22B 500V,<br>AC-21B 690V   | AC-21B 690V   |
| - Suitable for fuses              | 10x38 gG or aM   |           | 14x51 gG or aM  | 22x58 gG or aM  |
| - Maximum conductor cross section | 16mm <sup>2</sup> flexible/stranded;<br>25mm <sup>2</sup> rigid/solid    |           | 25mm <sup>2</sup> flexible/stranded;<br>35mm <sup>2</sup> rigid/solid | 35mm <sup>2</sup> flexible/stranded;<br>50mm <sup>2</sup> rigid/solid |
| Certifications obtained           | UR, CSA  | -         | cURus   | cURus   |
| Compliant with standards          | IEC/EN 60947-1, IEC/EN 60947-3,<br>RoHS directive, UL512, CSA C22.2 n°39 |           |   |   |

UR: UL Recognized; cURus: UL Recognized for USA and Canada.

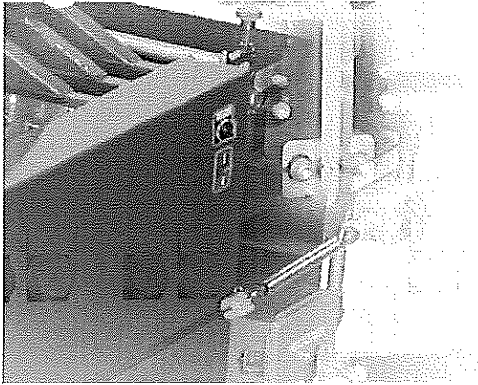

# Fuse holders **CC** RANGE



FB01 C...


LOVATO Electric fuse holders for class CC fuses are used to protect branch circuits, consisting of conductors and components following the last overcurrent protective device protecting a load, in industrial applications which require high breaking capacity.

Suitable only and exclusively for fitting fuses defined as "class CC", quite common on the North American market.

Usage: Service industry, electric panels onboard machinery, electric installations in general.

| Fuse size                         | Class CC   |
|-----------------------------------|--|
| Version without indicator         | 1P, 2P, 3P   |
| Version with indicator            | 1P   |
| <b>Main characteristics</b>       |  |
| - Rated voltage                   | 600VAC   |
| - Rated current                   | 30A  |
| - Utilisation category            | AC-22B 500V,<br>AC-21B 690V  |
| - Suitable for fuses              | 10x38 class CC   |
| - Maximum conductor cross section | 16mm <sup>2</sup> flexible/stranded;<br>25mm <sup>2</sup> rigid/solid    |
| Certifications obtained           | UR, CSA  |
| Compliant with standards          | IEC/EN 60947-1,<br>IEC/EN 60947-3,<br>RoHS directives,<br>CSA 22.2 n° 39 |


ВРЪЗКА  
ОПРЕДЕЛЕНИЕ

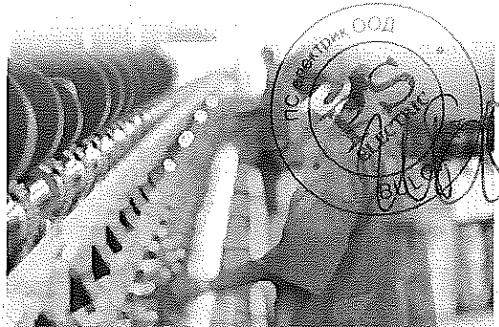



## Fuse holders

# DC



FB01 D...

LOVATO Electric DC fuse holder range is suitable for 1000VDC rated voltage and gPV class.


Used for overload and short-circuit protection of photovoltaic modules (strings) and the relative connecting cables.

| Fuse size                         | 10x38  |
|-----------------------------------|--|
| Version without indicator         | 1P, 2P   |
| Version with indicator            | 1P   |
| <b>Main characteristics</b>       |  |
| - Rated voltage                   | 1000VDC / 690VAC   |
| - Rated current                   | 32A  |
| - Utilisation category            | DC-20B 1000VDC, AC-21B 690V  |
| - Suitable for fuses              | 10x38 gPV  |
| - Maximum conductor cross section | 16mm <sup>2</sup> flexible/stranded, 25mm <sup>2</sup> rigid/solid |
| <b>Compliant with standards</b>   | IEC/EN 60947-1, IEC/EN 60947-3, RoHS directive                     |



## Fuses

# DC




FE01 D 0...

LOVATO Electric offers a range of cylindrical 10x38 fuses dedicated to photovoltaic duty and designed for 1000VDC maximum use.

Contrary to AC type fuses that blow for high overcurrent values, this type of DC fuse is designed to blow with low-intensity overcurrent values, created on photovoltaic cells and panels.

| Fuses for photovoltaic application |         |
|------------------------------------|---------|
| Breaking capacity                  | 30kA    |
| <b>Main characteristics</b>        |         |
| - Rated voltage                    | 1000VDC |
| - Rated current                    | 2...20A |

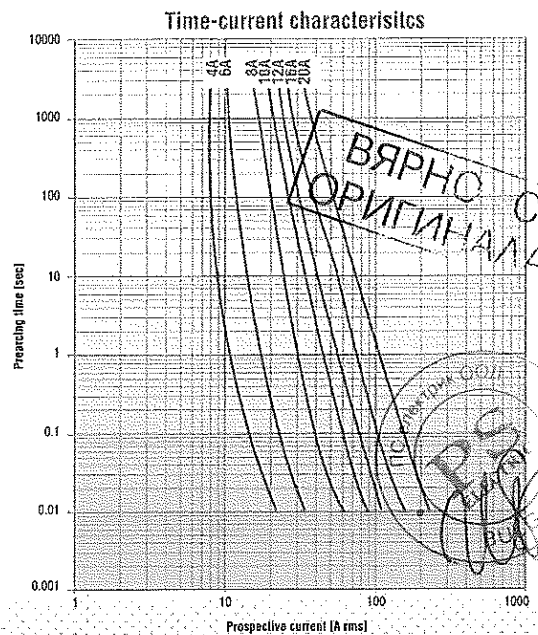


## TECHNICAL CHARACTERISTICS


| Type  | FB01 A...         | FB01 B...                  | FB02 A...                  | FB03 A...                  | FB01 C...                  | FB01 D...                   |                            |
|---|-------------------|----------------------------|----------------------------|----------------------------|----------------------------|-----------------------------|----------------------------|
| Range   | AC                | AC                         | AC                         | AC                         | Class CC (AC)              | DC                          |                            |
| Certifications obtained   | UR, CSA           | —                          | cURus                      | cURus                      | UL, CSA                    | —                           |                            |
| Maximum power dissipation   | 3W                | 3W                         | 5W                         | 9.5W                       | 3W                         | 4W                          |                            |
| Derating factor of current I <sub>e</sub> for different ambient temperatures      | 20°C              | 1                          | 1                          | 1                          | 1                          | 1                           |                            |
|   | 30°C              | 0.95                       | 0.95                       | 0.95                       | 0.95                       | 0.95                        |                            |
|   | 40°C              | 0.9                        | 0.9                        | 0.9                        | 0.9                        | 0.9                         |                            |
|   | 50°C              | 0.8                        | 0.8                        | 0.8                        | 0.8                        | 0.8                         |                            |
|   | 60°C              | 0.7                        | 0.7                        | 0.7                        | 0.7                        | 0.7                         |                            |
| Derating factor of current I <sub>e</sub> for sid-by-side fuse holders - n° poles | 1-3               | 1                          | 1                          | 1                          | 1                          | 1                           |                            |
|   | 4-6               | 0.8                        | 0.8                        | 0.8                        | 0.8                        | 0.8                         |                            |
|   | 7-9               | 0.7                        | 0.7                        | 0.7                        | 0.7                        | 0.7                         |                            |
|   | >10               | 0.6                        | 0.6                        | 0.6                        | 0.6                        | 0.6                         |                            |
| Voltage for status indicator  | 120...690VAC      | 120...690VAC               | 230...690VAC               | 230...690VAC               | 120...600VAC               | 350...1000VDC               |                            |
| <b>CONNECTIONS</b>  |                   |                            |                            |                            |                            |                             |                            |
| Maximum tightening torque   | 2.5Nm/22lbin      | 2.5Nm/22lbin               | 3Nm/26lbin                 | 4Nm/35lbin                 | 2.5Nm/22lbin               | 2.5Nm/22lbin                |                            |
| Maximum conductor cross section   | flexible/stranded | 1-16mm <sup>2</sup> /8 AWG | 1-16mm <sup>2</sup> /6 AWG | 1-25mm <sup>2</sup> /4 AWG | 1-35mm <sup>2</sup> /2 AWG | 1-16mm <sup>2</sup> /8 AWG  | 1-16mm <sup>2</sup> /6 AWG |
|   | rigid/solid       | 1-25mm <sup>2</sup> /8 AWG | 1-25mm <sup>2</sup> /4 AWG | 1-35mm <sup>2</sup> /2 AWG | 1-50mm <sup>2</sup> /1 AWG | 1-25mm <sup>2</sup> /10 AWG | 1-25mm <sup>2</sup> /4 AWG |
| <b>AMBIENT CONDITIONS</b>   |                   |                            |                            |                            |                            |                             |                            |
| Operating temperature   | -20...+70°C       | -20...+70°C                | -20...+70°C                | -20...+70°C                | -20...+70°C                | -20...+70°C                 |                            |
| Storage temperature   | -40...+80°C       | -40...+80°C                | -40...+80°C                | -40...+80°C                | -40...+80°C                | -40...+80°C                 |                            |
| <b>HOUSING</b>  |                   |                            |                            |                            |                            |                             |                            |
| Din rail mount version  | Yes               | Yes                        | Yes                        | Yes                        | Yes                        | Yes                         |                            |
| Degree of protection  | IP20              | IP20                       | IP20                       | IP20                       | IP20                       | IP20                        |                            |

## DIMENSIONS


FB01 A... FB01 B... FB01 C... FB01 D...



FB02 A...

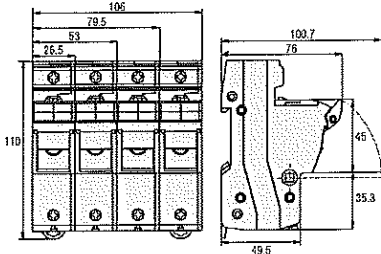


FB03 A...

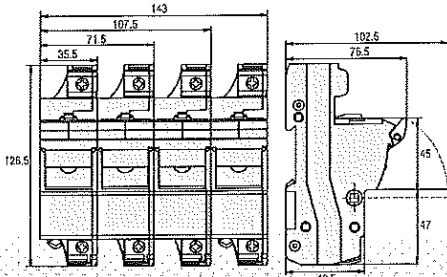

## ASSEMBLY

Accessories: Coupling elements (clips and pins) to mount and fix fuse holders side by side

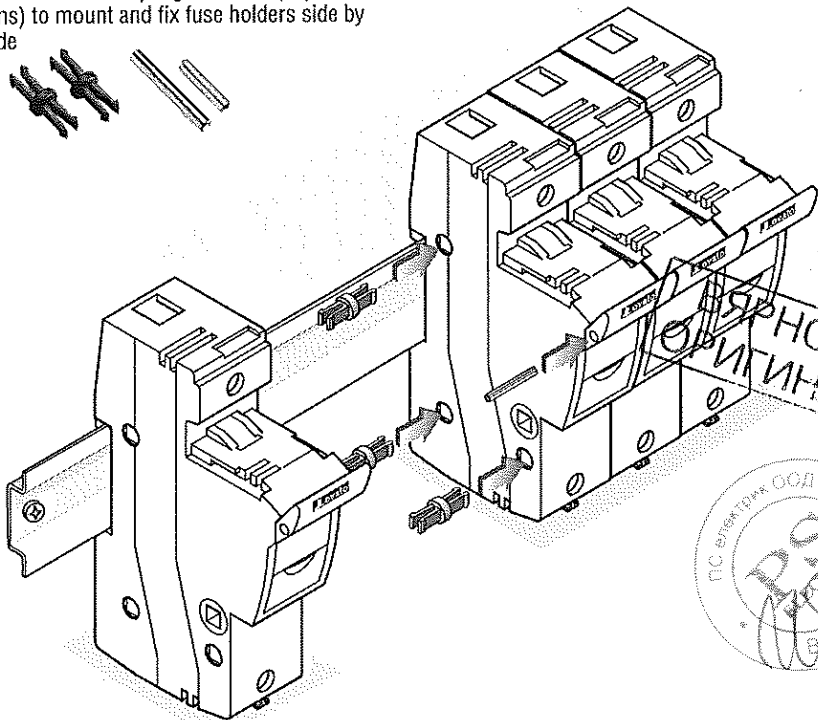

**Lovato**  
electric



## HOW TO ORDER

### FUSE HOLDERS

| Order code   | Pole arrangement | DiN modules n° | Status indicator | Rated voltage Ue [V] | Rated nominal Ie [A] | Qty per pkg n° | Weight [kg] |
|--|------------------|----------------|------------------|----------------------|----------------------|----------------|-------------|
| Fuse holder (fuse disconnecter), 10x38, certified by UR and CSA.       |                  |                |                  |                      |                      |                |             |
| FB01 A 1P  | 1 pole           | 1              | -                | 690VAC               | 32                   | 12             | 0.750       |
| FB01 A 1PL   | 1 pole           | 1              | Yes              | 690VAC               | 32                   | 12             | 0.750       |
| FB01 A 1N  | 1 pole + N       | 2              | -                | 690VAC               | 32                   | 6              | 0.750       |
| FB01 A 2P  | 2 poles          | 2              | -                | 690VAC               | 32                   | 6              | 0.750       |
| FB01 A 3P  | 3 poles          | 3              | -                | 690VAC               | 32                   | 4              | 0.750       |
| FB01 A 3N  | 3 poles + N      | 4              | -                | 690VAC               | 32                   | 3              | 0.750       |
| Fuse holder (fuse disconnecter), 14x51, certified by cURus.            |                  |                |                  |                      |                      |                |             |
| FB02 A 1P  | 1 pole           | 1.5            | -                | 690VAC               | 50                   | 6              | 1.000       |
| FB02 A 1PL   | 1 pole           | 1.5            | Yes              | 690VAC               | 50                   | 6              | 1.000       |
| FB02 A 1N  | 1 pole + N       | 3              | -                | 690VAC               | 50                   | 3              | 1.000       |
| FB02 A 2P  | 2 poles          | 3              | -                | 690VAC               | 50                   | 3              | 1.000       |
| FB02 A 3P  | 3 poles          | 4.5            | -                | 690VAC               | 50                   | 2              | 1.000       |
| FB02 A 3N  | 3 poles + N      | 6              | -                | 690VAC               | 50                   | 1              | 0.650       |
| Fuse holder (fuse disconnecter), 22x58, certified by cURus.            |                  |                |                  |                      |                      |                |             |
| FB03 A 1P  | 1 pole           | 2              | -                | 690VAC               | 125                  | 6              | 1.050       |
| FB03 A 1PL   | 1 pole           | 2              | Yes              | 690VAC               | 125                  | 6              | 1.050       |
| FB03 A 1N  | 1 pole + N       | 4              | -                | 690VAC               | 125                  | 3              | 1.050       |
| FB03 A 2P  | 2 poles          | 4              | -                | 690VAC               | 125                  | 3              | 1.050       |
| FB03 A 3P  | 3 poles          | 6              | -                | 690VAC               | 125                  | 2              | 1.050       |
| FB03 A 3N  | 3 poles + N      | 8              | -                | 690VAC               | 125                  | 1              | 0.70c       |
| Fuse holder (fuse disconnecter), class CC, certified by UL and GSA.    |                  |                |                  |                      |                      |                |             |
| FB01 C 1P  | 1 pole           | 1              | -                | 600VAC               | 30                   | 12             | 0.750       |
| FB01 C 1PL   | 1 pole           | 1              | Yes              | 600VAC               | 30                   | 12             | 0.750       |
| FB01 C 2P  | 2 poles          | 2              | -                | 600VAC               | 30                   | 6              | 0.750       |
| FB01 C 3P  | 3 poles          | 3              | -                | 600VAC               | 30                   | 4              | 0.750       |
| Fuse holder (fuse disconnecter), 10x38.                                |                  |                |                  |                      |                      |                |             |
| FB01 B 1P  | 1 pole           | 1              | -                | 690VAC               | 32                   | 12             | 0.750       |
| FB01 B 1PL   | 1 pole           | 1              | Yes              | 690VAC               | 32                   | 12             | 0.750       |
| FB01 B 1N  | 1 pole + N       | 2              | -                | 690VAC               | 32                   | 6              | 0.750       |
| FB01 B 2P  | 2 poles          | 2              | -                | 690VAC               | 32                   | 6              | 0.750       |
| FB01 B 3P  | 3 poles          | 3              | -                | 690VAC               | 32                   | 4              | 0.750       |
| FB01 B 3N  | 3 poles + N      | 4              | -                | 690VAC               | 32                   | 3              | 0.750       |
| Fuse holder (fuse disconnecter), 10x38, for photovoltaic applications. |                  |                |                  |                      |                      |                |             |
| FB01 D 1P  | 1 pole           | 1              | -                | 1000VDC              | 32                   | 12             | 0.750       |
| FB01 D 1PL   | 1 pole           | 1              | Yes              | 1000VDC              | 32                   | 12             | 0.750       |
| FB01 D 2P  | 2 poles          | 2              | -                | 1000VDC              | 32                   | 6              | 0.750       |

### FUSES FOR PHOTOVOLTAIC APPLICATIONS


| Order code   | Rated breaking capacity [kA] | Rated voltage Ue [V] | Rated current Ie [A] | Qty per pkg n° | Weight [kg] |
|--------------|------------------------------|----------------------|----------------------|----------------|-------------|
| FE01 D 00200 | 30                           | 1000VDC              | 2                    | 10             | 0.130       |
| FE01 D 00400 | 30                           | 1000VDC              | 4                    | 10             | 0.130       |
| FE01 D 00600 | 30                           | 1000VDC              | 6                    | 10             | 0.130       |
| FE01 D 00800 | 30                           | 1000VDC              | 8                    | 10             | 0.130       |
| FE01 D 01000 | 30                           | 1000VDC              | 10                   | 10             | 0.130       |
| FE01 D 01200 | 30                           | 1000VDC              | 12                   | 10             | 0.130       |
| FE01 D 01600 | 30                           | 1000VDC              | 16                   | 10             | 0.130       |
| FE01 D 02000 | 30                           | 1000VDC              | 20                   | 10             | 0.130       |

### ACCESSORIES

| Order code | Description                                    | Qty per pkg n° | Weight [kg] |
|------------|--|----------------|-------------|
| FBX 00     | Coupling clip for 10x38, 14x51 and 22x58 sizes | 100            | 0.050       |
| FBX 01     | Coupling pin for 10x38 size                    | 100            | 0.130       |
| FBX 02     | Coupling pin for 14x51 and 22x58 sizes         | 100            | 0.150       |

N.B. Two clips FBX 00 and one pin FBX 01 are needed to couple two fuse holder FB01... types.  
Three clips FBX 00 and one pin FBX 02 are needed to couple two fuse holder FB02... and FB03... types.


### WIRING DIAGRAMS




**Lovato**  
electric

**new**


**2011**




Switch disconnectors  
16 to 1600A

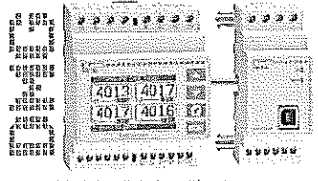


Modular digital multimeters



Flush-mount digital multimeters  
and power analyzers




Energy meters



Automatic transfer switch  
controllers



Switching power supplies



**Planet Switch**

- Motor protection circuit breakers
- Switch disconnectors
- Contactors
- Motor protection relays
- Electromechanical starters
- Control and signalling units
- Limit, micro and foot switches
- Rotary cam switches

**Planet Din**

- Modular contactors
- Time relays
- Protection relays
- Level control relays
- Earth leakage relays
- Fuse holders

**Planet Logic**

- Metering instruments and current transformers
- Soft starters
- AC motor drives
- Automatic power factor controllers
- Automatic battery chargers
- Automatic transfer switch controllers
- Programmable logic relays
- Switching power supplies
- Expansion modules and accessories

[www.LovatoElectric.com](http://www.LovatoElectric.com)

**LOVATO ELECTRIC S.P.A.**  
CONTROL SOLUTIONS FOR INDUSTRY  
VIA DON E. MAZZA, 12 - 24020 GORLE (BERGAMO) ITALY  
Tel. +39 035 4282111 Fax +39 035 4282200  
E-mail: [info@LovatoElectric.com](mailto:info@LovatoElectric.com)

Sales department: Tel. +39 035 4282354 - Fax +39 035 4282400

**LOVATO Electric offices in the world**

**United Kingdom**  
LOVATO (UK) LTD  
Tel. +44 8458 110023  
[www.Lovato.co.uk](http://www.Lovato.co.uk)

**Czech Republic**  
LOVATO S.R.O.  
Tel. +420 382 265482  
[www.Lovato.cz](http://www.Lovato.cz)

**Germany**  
DELTEC LOVATO GmbH  
Tel. +49 7237 1733  
[www.DeltecLovato.de](http://www.DeltecLovato.de)

**USA**  
LOVATO ELECTRIC INC  
Tel. +1 757 545 4700  
[www.LovatoUsa.com](http://www.LovatoUsa.com)

**Spain**  
LOVATO ELECTRIC S.L.U.  
Tel. +34 93 7812016  
[www.LovatoElectric.es](http://www.LovatoElectric.es)

**Canada**  
LOVATO ELECTRIC CORPORATION  
Tel. +1 450 681 9200  
[www.Lovato.ca](http://www.Lovato.ca)

**Poland**  
LOVATO ELECTRIC SP. Z O.O.  
Tel. +48 71 7979010  
[www.LovatoElectric.pl](http://www.LovatoElectric.pl)

**Mexico**  
LOVATO ELECTRIC DE MEXICO, S.A. DE C.V.  
Tel. +52 555 3415662  
[www.LovatoElectric.com.mx](http://www.LovatoElectric.com.mx)



Present in over 90 countries


The products described in this publication are subject to be revised or improved at any moment. Catalogue descriptions and details, such as technical and operational data, drawings, diagrams and instructions, etc., do not have any contractual value. In addition, products should be installed and used by qualified personnel and in compliance with the regulations in force for electrical systems in order to avoid damages and safety hazards.

[ClaroEmporioCreativo@gmail.com](mailto:ClaroEmporioCreativo@gmail.com)

*Handwritten signature*

24


10



Page 12-2

**AC FUSE HOLDERS**


- Version without indicator: 1P, 1P+N, 2P, 3P, 3P+N
- Version with indicator: 1P
- For fuses 10x38, 14x51 and 22x58mm IEC class gG or aM.
- Rated current: 32A, 50A, 125A
- Rated voltage: 690VAC.



Page 12-2

**AC FUSE HOLDERS CLASS CC FOR NORTH AMERICAN MARKET**

- Version without indicator: 1P, 2P, 3P
- Version with indicator: 1P
- For 10x38mm UL/CSA class CC fuses
- Rated current: 30A
- Rated voltage: 600VAC.



Page 12-3

**DC FUSE HOLDERS FOR PHOTOVOLTAIC APPLICATIONS**

- Version without indicator: 1P, 2P
- Version with indicator: 1P, 2P
- For 10x38mm IEC class gPV fuses
- Rated current: 32A
- Rated voltage: 1000VDC
- IEC utilisation category: DC20B.




Page 12-3

**DC FUSES FOR PHOTOVOLTAIC APPLICATIONS**


- 10x38mm, IEC class gPV
- Rated current: 20A
- Rated voltage: 1000VDC.

Handwritten arrow pointing downwards

ВЯРНУ  
НАМНИ



Handwritten signature

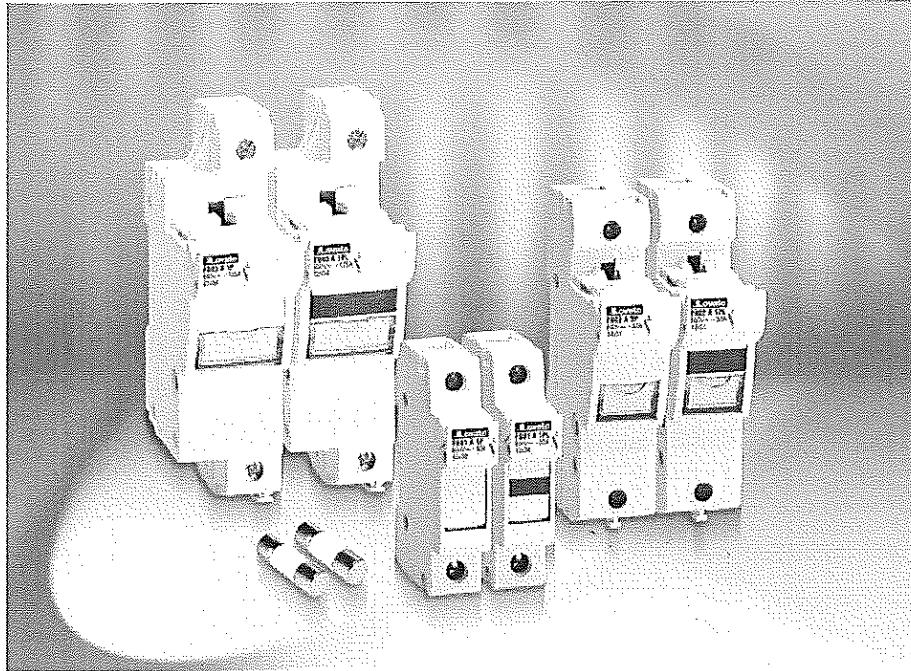


- Modular size for 10x38, 14x51 and 22x58mm fuses
- Finger safe - IP20 IEC degree of protection against accidental contact with live parts and with sealable cover for operators' safety
- Version with status indicator to quickly determine if the fuse is still operative or needs to be replaced
- UL and CSA certified versions.

**Fuse holders**

|  | SEC. - PAGE   |
|--|---------------|
| AC fuse holders.....                               | 12 - 2        |
| DC fuse holders for photovoltaic applications..... | 12 - 3        |
| <b>Fuses for photovoltaic applications</b> .....   | <b>12 - 3</b> |
| <b>Accessories</b> .....                           | <b>12 - 3</b> |
| <br>   |               |
| <b>Dimensions</b> .....                            | <b>12 - 4</b> |
| <b>Wiring diagrams</b> .....                       | <b>12 - 4</b> |
| <b>Technical characteristics</b> .....             | <b>12 - 5</b> |

ВЯРНО С  
ОРИГИНАЛА



moduLo

*my*




**Lovato**  
**electric**

# Fuse holders

## AC fuse holders



### Fuse holders UL Recognized and CSA certified

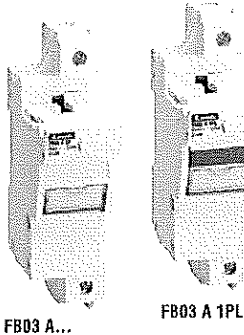

| Order code | Pole arrangement | Status indicator | DIN size | Qty per pkg | Wt [kg] |
|------------|------------------|------------------|----------|-------------|---------|
|            |                  |                  | n°       | n°          | [kg]    |

For 10x38mm fuses.  
32A rated current at 690VAC.

|            |      |     |   |    |       |
|------------|------|-----|---|----|-------|
| FB01 A 1P  | 1P   | —   | 1 | 12 | 0.066 |
| FB01 A 1PL | 1P   | YES | 1 | 12 | 0.065 |
| FB01 A 1M  | 1P+N | —   | 1 | 12 | 0.062 |
| FB01 A 1N  | 1P+N | —   | 2 | 6  | 0.134 |
| FB01 A 2P  | 2P   | —   | 2 | 6  | 0.132 |
| FB01 A 3P  | 3P   | —   | 3 | 4  | 0.188 |
| FB01 A 3N  | 3P+N | —   | 4 | 3  | 0.260 |

For 14x51mm fuses.  
50A rated current at 690VAC.

|            |      |     |   |    |       |
|------------|------|-----|---|----|-------|
| FB02 A 1P  | 1P   | —   | 1 | 12 | 0.113 |
| FB02 A 1PL | 1P   | YES | 1 | 12 | 0.114 |
| FB02 A 1N  | 1P+N | —   | 2 | 6  | 0.237 |
| FB02 A 2P  | 2P   | —   | 2 | 6  | 0.224 |
| FB02 A 3P  | 3P   | —   | 3 | 4  | 0.335 |
| FB02 A 3N  | 3P+N | —   | 4 | 3  | 0.460 |

For 22x58mm fuses.  
125A rated current at 690VAC.

|            |      |     |   |    |       |
|------------|------|-----|---|----|-------|
| FB03 A 1P  | 1P   | —   | 1 | 12 | 0.167 |
| FB03 A 1PL | 1P   | YES | 1 | 12 | 0.167 |
| FB03 A 1N  | 1P+N | —   | 2 | 6  | 0.354 |
| FB03 A 2P  | 2P   | —   | 2 | 6  | 0.334 |
| FB03 A 3P  | 3P   | —   | 3 | 4  | 0.500 |
| FB03 A 3N  | 3P+N | —   | 4 | 3  | 0.720 |

⊖ Not certified.

### Operational characteristics

- IEC rated voltage  $U_e$ :
  - 690VAC (FB01 A 1M excluded)
  - 400VAC (FB01 A 1M only)
- IEC rated current  $I_e$ :
  - FB01 A: 32A
  - FB02 A: 50A
  - FB03 A: 125A
- IEC utilisation category:
  - FB01 A: AC22B 500V, AC21B 690V (except FB01 A 1M: AC22B 400V)
  - FB02 A: AC22B 500V, AC21B 690V
  - FB03 A: AC21B 690V
- Suitable for IEC fuse class: gG and aM
- IEC degree of protection: IP20.

### Certifications and compliance

Certifications obtained:

| Type                             | UL Recognized for USA (File E343395) | CSA certified (File 252040 class 6255) | UL Recognized for USA and Canada (File E343395) |
|----------------------------------|--------------------------------------|--|---|
| FB01 A 1P, FB01 A 1PL, FB01 A 1N | ⊙                                    | ⊙                                      | —   |
| FB02 A...                        | —                                    | —                                      | ⊙   |
| FB03 A...                        | —                                    | —                                      | ⊙   |


⊙ Certification obtained.

"UL Recognized": Products having this type of marking are intended for use as components of complete workshop-assembled equipment.

Compliant with standards: IEC/EN 60269-1, IEC/EN 60269-2, IEC/EN 60947-1, IEC/EN 60947-3, UL 4248-1, UL 4248-4, CSA C22.2 n°4248.1, CSA C22.2 n°4248.4.

12

### Fuse holders



| Order code | Pole arrangement | Status indicator | DIN size | Qty per pkg | Wt [kg] |
|------------|------------------|------------------|----------|-------------|---------|
|            |                  |                  | n°       | n°          | [kg]    |

For 10x38mm fuses.  
32A rated current at 690VAC.

|            |      |     |   |    |       |
|------------|------|-----|---|----|-------|
| FB01 B 1P  | 1P   | —   | 1 | 12 | 0.062 |
| FB01 B 1PL | 1P   | YES | 1 | 12 | 0.064 |
| FB01 B 1N  | 1P+N | —   | 2 | 6  | 0.127 |
| FB01 B 2P  | 2P   | —   | 2 | 6  | 0.128 |
| FB01 B 3P  | 3P   | —   | 3 | 4  | 0.185 |
| FB01 B 3N  | 3P+N | —   | 4 | 3  | 0.247 |

### Operational characteristics


- IEC rated voltage  $U_e$ : 690VAC
- IEC rated current  $I_e$ : 32A
- IEC utilisation category: AC22B 500V, AC21B 690V
- Suitable for IEC fuse class: gG and aM
- IEC degree of protection IP20.

### Reference standards

Compliant with standards: IEC/EN 60947-1, IEC/EN 60947-3, IEC/EN 60269-1, IEC/EN 60269-2.

ВЯРНО С  
ОРИГИНАЛА

### Fuse holders UL Listed and CSA certified for class CC fuses for North American market



| Order code | Pole arrangement | Status indicator | DIN size | Qty per pkg | Wt [kg] |
|------------|------------------|------------------|----------|-------------|---------|
|            |                  |                  | n°       | n°          | [kg]    |

For 10x38mm fuses.  
30A rated current at 600VAC.

|            |    |     |   |    |       |
|------------|----|-----|---|----|-------|
| FB01 C 1P  | 1P | —   | 1 | 12 | 0.070 |
| FB01 C 1PL | 1P | YES | 1 | 12 | 0.072 |
| FB01 C 2P  | 2P | —   | 2 | 6  | 0.140 |
| FB01 C 3P  | 3P | —   | 3 | 4  | 0.210 |

NOTE: UL Listed and CSA certified as "Fuseholders, Cartridge Fuse" for use with Class CC fuses. Interrupting rating 200,000 Amps rms symmetrical. Voltage rating 600V. Current rating 30A.

### Operational characteristics

- IEC rated voltage  $U_e$ : 600VAC
- IEC rated current  $I_e$ : 30A
- IEC utilisation category: AC22B 500V, AC21B 690V
- Suitable for UL/CSA fuse class: CC
- IEC degree of protection IP20.

### Certifications and compliance

Certifications obtained: UL Listed (File E343395) and CSA certified (File 252040 class 6225).  
Compliant with standards: IEC/EN 60269-1, IEC/EN 60269-2, IEC/EN 60947-1, IEC/EN 60947-3, UL 4248-1, UL 4248-4, CSA C22.2 n°4248.1, CSA C22.2 n°4248.4.


ВЯРНО С  
ОРИГИНАЛА

# Fuse holders

## DC fuse holders for photovoltaic applications.

### Accessories

### Fuse holders for photovoltaic applications



| Order code | Pole arrangement | Status indicator | DfN size | Qty per pkg | Wt   |
|------------|------------------|------------------|----------|-------------|------|
|            |                  |                  | n°       | n°          | [kg] |

For 10x38mm fuses.  
32A rated current at 1000VDC.

|            |    |     |   |    |       |
|------------|----|-----|---|----|-------|
| FB01 D 1P  | 1P | —   | 1 | 12 | 0.064 |
| FB01 D 1PL | 1P | YES | 1 | 12 | 0.065 |
| FB01 D 2P  | 2P | —   | 2 | 6  | 0.127 |
| FB01 D 2PL | 2P | YES | 2 | 6  | 0.130 |

#### Operational characteristics

- IEC rated voltage  $U_e$ : 1000VDC
- IEC rated current  $I_e$ : 32A
- IEC utilisation category: DC20B 1000VDC
- Suitable for IEC fuse class: gPV
- IEC degree of protection: IP20.

#### Reference standards

Compliant with standards: IEC/EN 60269-1, IEC/EN 60269-2, IEC/EN 60947-1, IEC/EN 60947-3.

### Fuses for photovoltaic applications



| Order code | Rated current $I_n$ | Qty per pkg | Wt   |
|------------|---------------------|-------------|------|
|            | [A]                 | n°          | [kg] |

For 10x38mm fuses.  
30kA breaking capacity at 1000VDC.

|              |    |    |       |
|--------------|----|----|-------|
| FE01 D 00200 | 2  | 10 | 0.008 |
| FE01 D 00400 | 4  | 10 | 0.008 |
| FE01 D 00600 | 6  | 10 | 0.008 |
| FE01 D 00800 | 8  | 10 | 0.008 |
| FE01 D 01000 | 10 | 10 | 0.008 |
| FE01 D 01200 | 12 | 10 | 0.008 |
| FE01 D 01600 | 16 | 10 | 0.008 |
| FE01 D 02000 | 20 | 10 | 0.008 |

#### Operational characteristics

- IEC rated voltage  $U_e$ : 1000VDC
- IEC rated current  $I_e$ : 2-20A
- IEC fuse class: gPV.

#### Reference standards

Compliant with standards: IEC/EN 60269-6.

### Accessories



| Order code | Description                                      | Qty per pkg | Wt    |
|------------|--|-------------|-------|
|            | [A]  | n°          | [kg]  |
| FBX 00     | Coupling clip for 10x38, 14x51 and 22x58mm sizes | 100         | 0.003 |
| FBX 01     | Coupling pin for 10x38mm size                    | 100         | 0.005 |
| FBX 02     | Coupling pin for 14x51 and 22x58mm sizes         | 100         | 0.008 |

For FB01 A... and FB01 B... types.

|        |   |    |       |
|--------|---|----|-------|
| FBX 05 | Three-phase connection busbar, for 57 modules in total, 1m/3.3ft long | 10 | 0.465 |
| FBX 07 | One-pole terminal for 25mm <sup>2</sup> max conductor                 | 25 | 0.010 |
| FBX 08 | One-pole terminal for 50mm <sup>2</sup> max conductor                 | 25 | 0.020 |
| FBX 11 | End cap for FBX05 busbar  | 50 | 0.001 |

ⓘ Not suitable for FB01 B1N, FB01 B2P, FB01 B3P and FB01 B3N types.

#### General and operational characteristics

##### THREE-PHASE BUSBAR

- Central point of power supply: 130A max
- Side point of power supply: 80A max
- Pitch: 18mm/0.7in
- Busbar section: 10mm<sup>2</sup>
- Number of modules/poles: 57
- For paralleling connection
- Length (standard supplied): 1m/3.3ft which can be cut in shorter sections.

FBX 05




FBX 07



FBX 08

FBX 11

#### Fuse holder assembly in multiple pole configuration

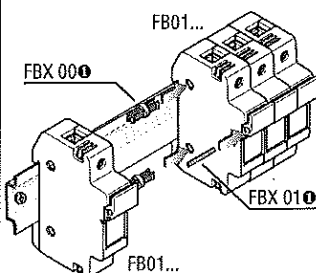

ⓘ Not suitable for FB01 B1N, FB01 B2P, FB01 B3P and FB01 B3N types.

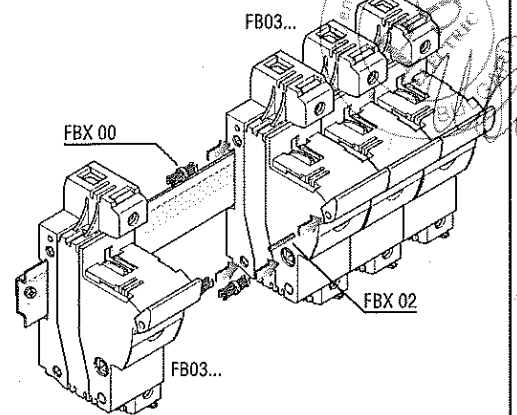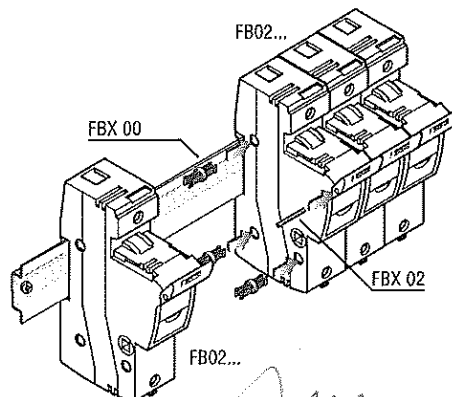

ВЯРНО С  
ОРИГИНАЛА




# Fuse holders

Dimensions [mm (in)]


10

## FUSE HOLDERS


FB01 A... FB01 B... FB01 C... FB01 D...

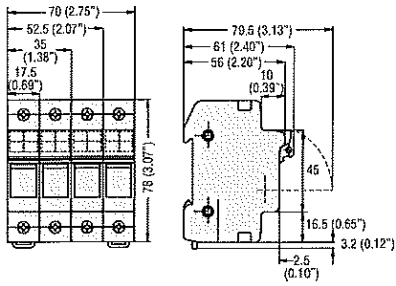

FB02 A...

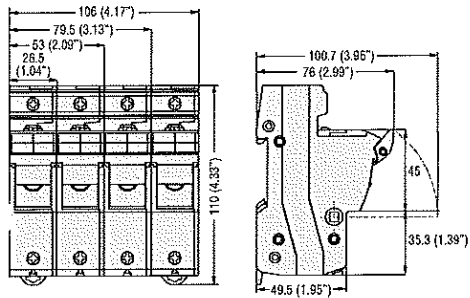

FB03 A...

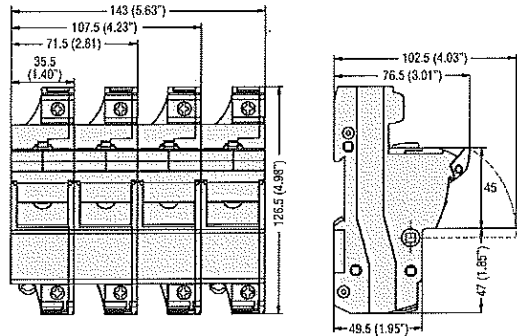


12

Handwritten mark resembling a stylized 'S' or '3'.


## FUSES

FE01 D 0...



ВЯРНО С  
ОРИГИНАЛА

## Wiring diagrams

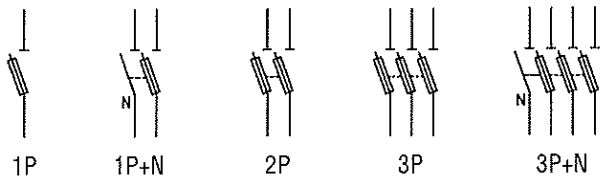

ГПС ВОЛОНТЕРЪК ООД  
R.S. ELECTRIC  
BULGARIA

Handwritten signature.

# Fuse holders

## Technical characteristics


| TYPE   | FB01 A...                               | FB01 B...  | FB02 A...                  | FB03 A...                  | FB01 C...                   | FB01 D...                  |
|--|---|--|----------------------------|----------------------------|-----------------------------|----------------------------|
| Range  | AC                                      |  |                            |                            | Class CC (AC)               | DC                         |
| IEC maximum rated current I <sub>n</sub>   | 32A                                     |  | 50A                        | 125A                       | 30A                         | 32A                        |
| IEC maximum rated voltage I <sub>n</sub>   | 690VAC;<br>400VAC Ⓢ                     | 690VAC   |                            |                            | 600VAC                      | 1000VDC                    |
| IEC utilisation category   | AC22B 500V; AC21B 690V;<br>AC22B 400V Ⓢ |  |                            | AC21B 690V                 | AC22B 500V;<br>AC21B 690V   | DC20B 1000VDC              |
| Maximum power dissipation  | 3W                                      |  | 5W                         | 9.5W                       | 3W                          | 4W                         |
| Derating factor of current I <sub>n</sub><br>for different ambient temperatures          | 20°C                                    | 1  |                            |                            |                             |                            |
|  | 30°C                                    | 0.95   |                            |                            |                             |                            |
|  | 40°C                                    | 0.9  |                            |                            |                             |                            |
|  | 50°C                                    | 0.8  |                            |                            |                             |                            |
|  | 60°C                                    | 0.7  |                            |                            |                             |                            |
|  | 70°C                                    | 0.5  |                            |                            |                             |                            |
| Derating factor of current I <sub>n</sub><br>for side-by-side fuse holders -<br>n° poles | 1-4                                     | 1  |                            |                            |                             |                            |
|  | 5-6                                     | 0.8  |                            |                            |                             |                            |
|  | 7-9                                     | 0.7  |                            |                            |                             |                            |
|  | ≥10                                     | 0.6  |                            |                            |                             |                            |
| Voltage for status indicator   | 120...690VAC                            |  | 230...690VAC               |                            | 120...600VAC                | 350...1000VDC              |
| <b>CONNECTIONS</b>   |   |  |                            |                            |                             |                            |
| Maximum tightening torque  | 2.5Nm; 2Nm Ⓢ / 22lbin                   |  | 3Nm / 26lbin               | 4Nm / 35lbin               | 2.5Nm / 22lbin              |                            |
| Maximum conductor<br>cross section   | flexible/stranded                       | 1x16mm <sup>2</sup> ; 1-16mm <sup>2</sup> Ⓢ / 8AWG | 1x25mm <sup>2</sup> / 6AWG | 1x35mm <sup>2</sup> / 2AWG | 1x16mm <sup>2</sup> / 8AWG  | 1x16mm <sup>2</sup> / 6AWG |
|  | rigid/solid                             | 1x25mm <sup>2</sup> ; 1-10mm <sup>2</sup> Ⓢ / 8AWG | 1x35mm <sup>2</sup> / 8AWG | 1x50mm <sup>2</sup> / 1AWG | 1x25mm <sup>2</sup> / 10AWG | 1x25mm <sup>2</sup> / 4AWG |
| <b>AMBIENT CONDITIONS</b>  |   |  |                            |                            |                             |                            |
| Operating temperature  | -20...+70°C                             |  |                            |                            |                             |                            |
| Storage temperature  | -40...+80°C                             |  |                            |                            |                             |                            |
| Maximum altitude   | 3,000m                                  |  |                            |                            |                             |                            |
| Operation position   | Any                                     |  |                            |                            |                             |                            |
| Fixing   | On 35mm DIN rail (IEC/EN 60715)         |  |                            |                            |                             |                            |
| Ⓢ Values valid only for FB01 A 1M type.  |   |  |                            |                            |                             |                            |

12

### TECHNICAL CHARACTERISTICS FOR FE01 D... FUSES

| TYPE         | Rated current [A] | Power consumption at 0.7 I <sub>n</sub> [W] | Power consumption at I <sub>n</sub> [W] | Prearcing I <sup>2</sup> t [A <sup>2</sup> s] | Total I <sup>2</sup> t at 1000VDC [A <sup>2</sup> s] |
|--------------|-------------------|---|---|---|--|
| FE01 D 00200 | 2                 | 0.62  | 1.54                                    | 1.78  | 6.5  |
| FE01 D 00400 | 4                 | 0.73  | 1.84                                    | 3   | 11   |
| FE01 D 00600 | 6                 | 0.96  | 2.4                                     | 8.5   | 32   |
| FE01 D 00800 | 8                 | 1.02  | 2.55                                    | 25  | 93   |
| FE01 D 01000 | 10                | 1.03  | 2.58                                    | 11  | 52   |
| FE01 D 01200 | 12                | 1.04  | 2.6                                     | 25  | 116  |
| FE01 D 01600 | 16                | 1.08  | 2.7                                     | 33  | 152  |
| FE01 D 02000 | 20                | 1.16  | 2.9                                     | 85  | 390  |

### TIME-CURRENT CHARACTERISTICS FOR FE01 D... FUSES

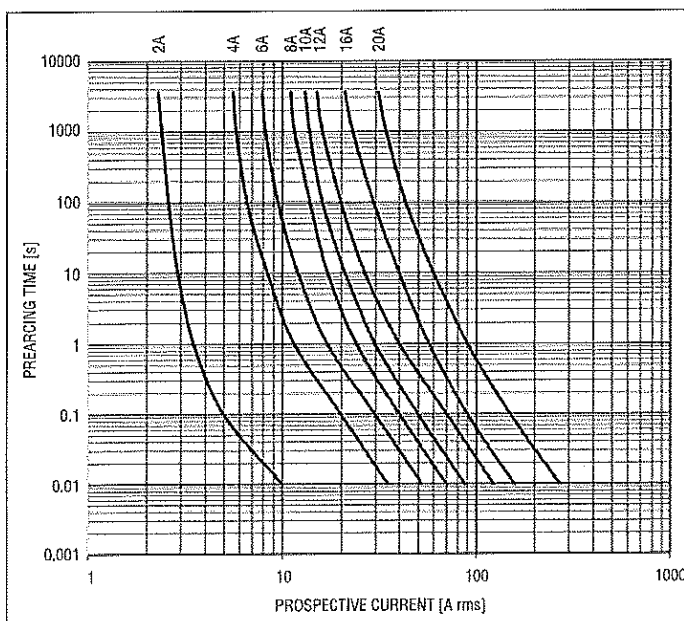


ВЯРНО С  
ОРИГИНАЛА



*Handwritten signature*

3  
Lov

h



### ДЕКЛАРАЦИЯ ЗА СЪОТВЕТВИЕ

Долуподписаният, Владимир Лазаров- Управител на ВИБ-ИЗОМАТИК ООД,

В качеството си на търговски представител на Phoenix Contact GmbH и Lovato Electric за България


Декларирам че, материалите, с които се асемблират клемореди тип ИК7ТКЗР, отговарят на следните стандарти и нормативни актове:

-Клеми тип URTK/S и аксесоари за тях, производство на Phoenix Contact GmbH отговарят на следните технически одобрения и нормативни актове IEC 60947-7-1

-Разединяеми предпазител-разединители тип FBI, производство на Lovato Electric отговарят на следните технически одобрения и нормативни актове : IEC/EN 60269-1, IEC/EN 60269-2, IEC/EN 60947-1, IEC/EN 60947-3.


h

25.10.2013

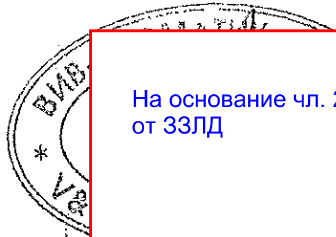

На основание чл. 2  
от ЗЗЛД

ВЯРНО С  
РИГИНАЛА

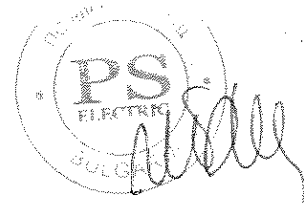

h

*[Handwritten signature]*

*4*  
*low*

DEVICE UNDER TEST..... Fuse holder *FB01B types*

MANUFACTURER..... Lovato Electric S.p.A.

TYPE OF TEST..... Temperature rise test on FB01B fuse holders

DATE OF DEVICE RECEIPT..... 27/04/2011

START / END TESTING ..... 29/04/2011 – 13/05/2011

SAMPLES STORING.....  Eliminated / returned to customer     Storage :

|            |                            |   |
|------------|----------------------------|---|
| INDEX..... | 1. PURPOSE OF TESTING..... | 2 |
|            | 2. TEST SAMPLES.....       | 2 |
|            | 3. TEST METHOD.....        | 2 |
|            | 4. TEST PROCEDURES.....    | 2 |
|            | 5. TEST RESULTS .....      | 3 |
|            | 6. TEST EQUIPMENT .....    | 5 |
|            | 7. REMARKS & ANALYS.....   | 5 |
|            | 8. ANNEX.....              | 6 |


ISSUE ..... 16/05/2011

COMPILED ..... STAFF LPR

APPROVED..... RESP. LPR

*[Handwritten signature]*

ВЯРНО С  
ОРИГИНАЛА



The test results are related only to the exemplary tested and listed under the "test samples".

*[Handwritten signature]*



### 1. PURPOSE OF TESTING

Requested test (according to the customer specification):

Temperature rise at 690V – 32A on FB01B fuse holders

Test purpose:

“Verify the good function of FB01B fuse holders .”

Test target:

Pass the test.

### 2. TEST SAMPLES

N. 1 FB01B1P fuse holder - 32A (10 x 38 mm), batch production number ...<sup>1</sup>

N. 1 FB01B2P fuse holder - 32A (10 x 38 mm), batch production number ...<sup>1</sup>

N. 1 FB01B3P fuse holder - 32A (10 X 38 mm), batch production number ...<sup>1</sup>

### 3. TEST METHOD

IEC 60947-3 (2008-08) Ed. 3.0 + IEC 60947-1 Ed. 5.1 (2011-03)

Temperature rise (§ 8.3.3.1)



### 4. TEST PROCEDURES


Temperature rise..... Test instruction LPR 051-1, rev. 4, dated 11/10/2010.

<sup>1</sup> not available

<sup>1</sup> not available

<sup>1</sup> not available

ВЯРНО С  
ОРИГИНАЛА



The test results are related only to the exemplary tested and listed under the “test samples”.



## 5. TEST RESULTS

### 5.1 TEMPERATURE RISE

#### 5.1.1 WITH LEGRAND FUSE 32 A gG 400 V

Sample under test ..... N. 1 FB01B1P - 32A  
N. 1 FB01B2P - 32A  
N. 1 FB01B3P - 32A

#### Test conditions

Ambient temperature ..... 21 °C  
Relative humidity ..... 46 %  
Installation ..... in vertical way, on DIN RAIL 35mm

Data sheet fusible used:

- Supplier ..... Legrand
- Code ..... cod. 133 32

#### Test parameters

Wiring of the main circuit

- cables section / length ..... 6,0 mm<sup>2</sup> / 1,0 m
- screws tightening nominal torque ..... 2,0 ± 2,5 N.m
- screws applied tightening torque ..... 2,0 N.m


Supply of the main circuit

- rated current ..... I<sub>th</sub> = 25 - 32 A
- test current ..... I = 32 A
- supply frequency ..... 50 Hz

#### Test results

See next page.

ВЯРНО С  
ОРИГИНАЛА



The test results are related only to the exemplary tested and listed under the "test samples".




Temperature rise main circuit

|             | [K]                             |                               |                               | Standard limit<br>EN60947-1 tab. 2 |
|-------------|---------------------------------|-------------------------------|-------------------------------|------------------------------------|
|             | One pole fuse holder<br>FB01B1P | 2 pole fuse holder<br>FB01B2P | 3 pole fuse holder<br>FB01B3P |                                    |
| Terminal L1 | 43                              | 54                            | 57                            | 65                                 |
| Terminal T1 | 39                              | 51                            | 52                            | 65                                 |
| Terminal L2 | -                               | 55                            | 61                            | 65                                 |
| Terminal T2 | -                               | 49                            | 58                            | 65                                 |
| Terminal L3 | -                               | -                             | 57                            | 65                                 |
| Terminal T3 | -                               | -                             | 50                            | 65                                 |
| Note .....  | Silver plated-brass terminal    |                               |                               |                                    |


Temperature rise for accessible parts

|            | [K]                             |                               |                               | Standard limit<br>EN60947-1 tab. 3 |
|------------|---------------------------------|-------------------------------|-------------------------------|------------------------------------|
|            | One pole fuse holder<br>FB01B1P | 2 pole fuse holder<br>FB01B2P | 3 pole fuse holder<br>FB01B3P |                                    |
| Line side  | 14                              | 24                            | 29                            | 40                                 |
| Load side  | 10                              | 19                            | 21                            | 40                                 |
| Left side  | 24                              | 30                            | 32                            | 40                                 |
| Right side | 22                              | 30                            | 31                            | 40                                 |
| On front   | 18                              | 24                            | 29                            | 40                                 |
| Lever      | 9                               | 16                            | 17                            | 40                                 |

ВЯРНО С  
ОРИГИНАЛА



The test results are related only to the exemplary tested and listed under the "test samples".



## 6. TEST EQUIPMENT AND INSTRUMENTS

### 6.1. TEST EQUIPMENT

| Description            | Used for                  | Full scale | Code     |
|------------------------|---------------------------|------------|----------|
| Current supply station | Power supply main circuit | 20V – 50A  | LPRA 065 |


### 6.2. MEASURING INSTRUMENTS

| Description               | Used to measure                | Full scale    | Code       | Calibration expiration date |
|---------------------------|--------------------------------|---------------|------------|-----------------------------|
| Thermohygrometer          | Ambient temperature            | -5 ÷ 50 °C    | LPR 165    | 27/10/2011                  |
| Thermohygrometer          | Relative humidity              | 10 ÷ 90%      | LPR 165    | 27/10/2011                  |
| Termometric instrument    | Temperature rise               | -30 ÷ +200 °C | LPR 201    | 10/01/2012                  |
| Termocouple T type        | Temperature rise               | -30 ÷ +200 °C | LPR 201    | 10/01/2012                  |
| Termocouple T type        | Temperature rise               | -30 ÷ +200 °C | LPR 201.13 | 10/01/2012                  |
| Current transformer       | Main circuit current           | 1.004/50 A    | LPR 155    | 11/05/2014                  |
| Digital multimeter        | Main circuit current           | 10 A          | LPR 55     | 11/05/2012                  |
| Digital multimeter        | Drop voltage                   | mV - Autom.   | LPR 125    | 11/05/2012                  |
| Dynamometric screw driver | Main terminal screw tightening | 6,0 Nm        | LPR 231    | 07/01/2012                  |

## 7. REMARKS & ANALYS

Temperature rise test 690V – 32A: test passed

ВЯРНО С  
ОРИГИНАЛА



The test results are related only to the exemplary tested and listed under the "test samples".


*Handwritten signature*




*Handwritten signature*

8. ANNEX

Picture 1: Temperature rise – test setup

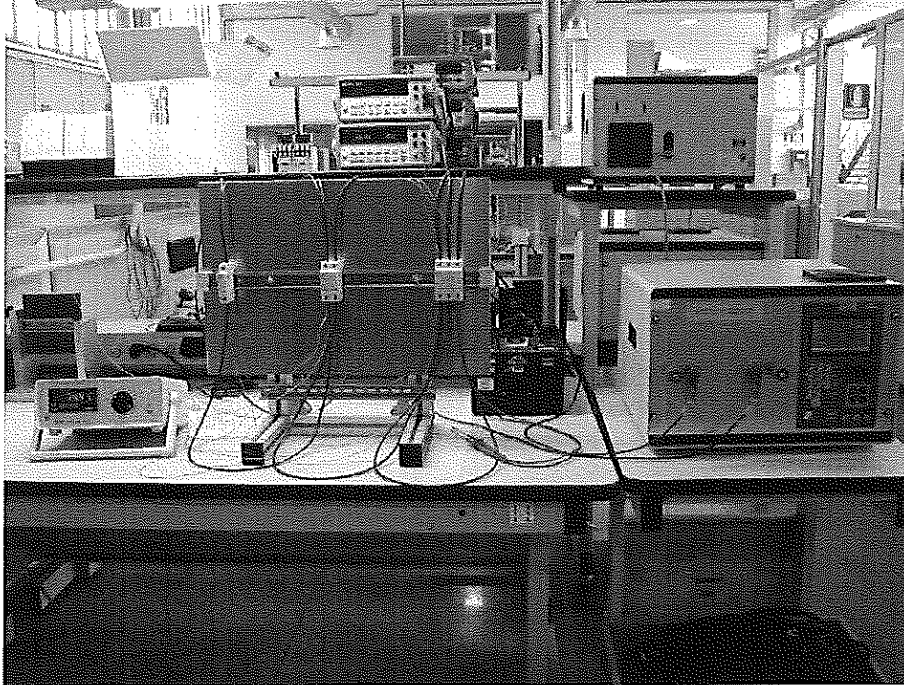


Picture 1a: Temperature rise – test setup

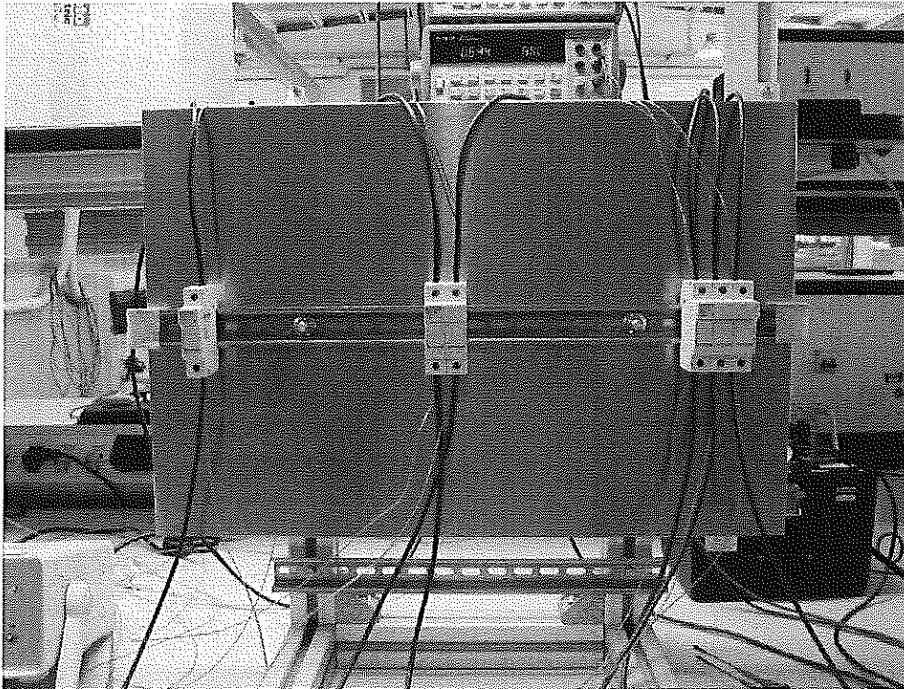

*Handwritten signature*

ВЪРНО С  
ОРИГИНАЛА




The test results are related only to the exemplary tested and listed under the "test samples".

*Handwritten signature*

Picture 2: Catalogue Legrand fuses

**Legrand**  
**fusibili cilindrici**

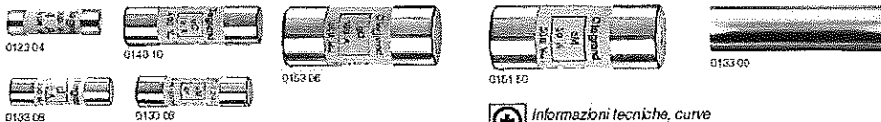


Informazioni tecniche, curve e quote (p. 122)

| Tipo "gG"  |         |                        |     | Tipo "aM"   |         |                 |      |
|--|---------|------------------------|-----|---|---------|-----------------|------|
| B.C.R. (Bassa Capacità di Rottura)<br>Rispondenti alle norme CEI 32-1, CEI 32-5 e<br>EN 60 269-1, EN 60 269-3                                    |         |                        |     | Rispondenti alla norma IEC EN 60269-1<br>Approvazione Bureau Veritas  |         |                 |      |
| Senza sigillatura  |         | Con sigillatura        |     | Senza sigillatura   |         | Con sigillatura |      |
| I (mA)   |         | U (V)                  |     | I (A)   |         | U (V)           |      |
| <b>8,5 x 23 mm</b>   |         |                        |     | <b>8,5 x 31,5 mm</b>  |         |                 |      |
| 10   | 0113 02 | 0114 02 <sup>(1)</sup> | 2   | 10  | 0120 01 |                 | 1    |
| 10   | 0113 04 | 0114 04 <sup>(1)</sup> | 4   | 10  | 0120 02 |                 | 2    |
| 10   | 0113 06 | 0114 06 <sup>(1)</sup> | 6   | 10  | 0120 04 |                 | 4    |
| 100  | 0113 10 | 0114 10                | 10  | 10  | 0120 06 |                 | 6    |
| <b>8,5 x 31,5 mm</b>   |         |                        |     | 3. 10   |         |                 |      |
| 10   | 0123 01 |                        | 1   | A.C.R. (Alta Capacità di Rottura)<br>Conformi alle norme IEC 60269-1, 2 e 2-1;<br>Approvazioni Bureau Veritas |         |                 |      |
| 10   | 0123 02 | 0124 02                | 2   | <b>10,3 x 38 mm</b>   |         |                 |      |
| 10   | 0123 04 | 0124 04                | 4   | 10  | 0130 01 |                 | 0,25 |
| 10   | 0123 06 | 0124 06                | 6   | 10  | 0130 05 |                 | 0,50 |
| 10   | 0123 08 |                        | 8   | 10  | 0130 01 |                 | 1    |
| 10   | 0123 10 | 0124 10                | 10  | 10  | 0130 02 |                 | 2    |
| 10   | 0123 12 |                        | 12  | 10  | 0130 04 |                 | 4    |
| 100  | 0123 16 | 0124 16                | 16  | 10  | 0130 06 |                 | 6    |
| 100  | 0123 20 | 0124 20                | 20  | 10  | 0130 08 |                 | 8    |
| <b>10,3 x 38 mm</b>  |         |                        |     | 10  | 0130 10 |                 | 10   |
| 100/10   | 0134 32 | 0134 32                | 32  | 10  | 0130 12 |                 | 12   |
| A.C.R. (Alta Capacità di Rottura)<br>Conformi alle norme CEI 32-1 e 32-4 -<br>IEC 60 269-1, 2 e 2-1 - EN 60 269-1<br>Approvazioni Bureau Veritas |         |                        |     | 10  | 0130 16 |                 | 16   |
| Senza sigillatura  |         | Con sigillatura        |     | 10  | 0130 20 |                 | 20   |
| I (A)  |         | U (V)                  |     | 10  | 0130 25 |                 | 25   |
| <b>10,3 x 38 mm</b>  |         |                        |     | <b>14 x 51 mm</b>   |         |                 |      |
| 10   | 0133 04 |                        | 0,5 | 10  | 0140 02 | 0141 02         | 2    |
| 10   | 0133 01 |                        | 1   | 10  | 0140 04 | 0141 04         | 4    |
| 10   | 0133 02 | 0134 02                | 2   | 10  | 0140 06 | 0141 06         | 6    |
| 10   | 0133 04 | 0134 04                | 4   | 10  | 0140 08 | 0141 08         | 8    |
| 10   | 0133 06 | 0134 06                | 6   | 10  | 0140 10 | 0141 10         | 10   |
| 10   | 0133 08 | 0134 08                | 8   | 10  | 0140 12 | 0141 12         | 12   |
| 10   | 0133 10 | 0134 10                | 10  | 10  | 0140 16 | 0141 16         | 16   |
| 10   | 0133 12 | 0134 12                | 12  | 10  | 0140 20 | 0141 20         | 20   |
| 10   | 0133 16 | 0134 16                | 16  | 10  | 0140 25 | 0141 25         | 25   |
| 10   | 0133 20 | 0134 20                | 20  | 10  | 0140 32 | 0141 32         | 32   |
| 10   | 0133 25 | 0134 25                | 25  | 10  | 0140 40 | 0141 40         | 40   |
| <b>14 x 51 mm</b>  |         |                        |     | 10  | 0140 45 | 0141 45         | 45   |
| 10   | 0143 02 |                        | 2   | 10  | 0140 50 |                 | 50   |
| 10   | 0143 04 | 0145 04                | 4   | <b>22 x 58 mm</b>   |         |                 |      |
| 10   | 0143 06 | 0145 06                | 6   | 10  | 0150 16 | 0151 16         | 16   |
| 10   | 0143 10 | 0145 10                | 10  | 10  | 0150 20 | 0151 20         | 20   |
| 10   | 0143 16 | 0145 16                | 16  | 10  | 0150 25 | 0151 25         | 25   |
| 10   | 0143 20 | 0145 20                | 20  | 10  | 0150 32 | 0151 32         | 32   |
| 10   | 0143 25 | 0145 25                | 25  | 10  | 0150 40 | 0151 40         | 40   |
| 10   | 0143 32 | 0145 32                | 32  | 10  | 0150 50 | 0151 50         | 50   |
| 10   | 0143 40 | 0145 40                | 40  | 10  | 0150 63 | 0151 63         | 63   |
| 10   | 0143 50 | 0145 50                | 50  | 10  | 0150 80 | 0151 80         | 80   |
| <b>22 x 58 mm</b>  |         |                        |     | 10  | 0150 96 | 0151 96         | 100  |
| 10   | 0153 10 | 0155 10                | 10  | 10  | 0150 97 | 0151 97         | 125  |
| 10   | 0153 16 | 0155 16                | 16  | <b>Neutri</b>   |         |                 |      |
| 10   | 0153 20 | 0155 20                | 20  | 10  | 0123 00 | 6,5 x 31,5      |      |
| 10   | 0153 25 | 0155 25                | 25  | 10  | 0133 00 | 10,3 x 38       |      |
| 10   | 0153 32 | 0155 32                | 32  | 10  | 0143 00 | 14 x 51         |      |
| 10   | 0153 40 | 0155 40                | 40  | 10  | 0153 00 | 22 x 58         |      |
| 10   | 0153 50 | 0155 50                | 50  | (1) Cablo non normalizzato  |         |                 |      |
| 10   | 0153 63 | 0155 63                | 63  |   |         |                 |      |
| 10   | 0153 80 | 0155 80                | 80  |   |         |                 |      |
| 10   | 0153 96 | 0155 96                | 100 |   |         |                 |      |
| 10   | 0153 97 | 0155 97                | 125 |   |         |                 |      |

*[Handwritten signature]*

**ВЕРНО С  
ОРИГИНАЛА**



*[Handwritten signature]*

International Electrotechnical  
Commission



IEC System of Conformity Assessment  
Schemes for Electrotechnical  
Equipment and Components (IECEE)

# CERTIFICATE OF ACCEPTANCE

TO PARTICIPATE IN THE IECEE CB-SCHEME AND FACTORY SURVEILLANCE SERVICE

**IMQ SpA**

Via Quintiliano 43 I-20138 Milano, Italy

has been assessed and determined to fully comply with the requirements of ISO/IEC 17065: 2012, The Basic Rules, IECEE 01: 2014-11 and Rules of Procedure IECEE 02: 2015-06, and the relevant IECEE CB-Scheme Operational Documents.

**IMQ SpA**

is therefore entitled to operate as an Italian Issuing and Recognising National Certification Body within the IECEE CB Scheme for the Scope (Product Category(ies) and Standard(s)) as listed in the relevant part of the IECEE Web Site at [www.iecee.org](http://www.iecee.org), and is subject to all other terms as set forth in the IECEE Basic Rules and Rules of Procedure.



This certificate remains valid until November 2<sup>nd</sup> 2018, at which time it will be reissued by the IECEE Executive Secretary upon successful completion of the normally scheduled 3-year Reassessment Programme administered by the IECEE CB Scheme.

На основание чл. 2  
от ЗЗЛД

ВЯРНО С  
ОРИГИНАЛА

Issue: 2016-06-16

ВЯРНО С  
ОРИГИНАЛА




*Handwritten signature*

*Handwritten signature*

*Handwritten mark*

*Handwritten mark*

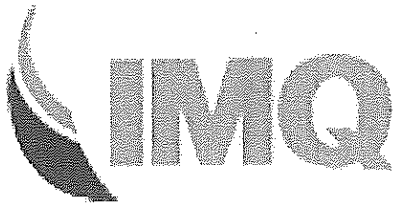

Ref. No. IMQ-311/CTF2

# RECOGNITION

WE DECLARE THAT

## LOVATO ELECTRIC S.p.A.

IN ITS TESTING LABORATORY

LABORATORIO DI PROVA (LPR)  
Via Don Emilio Mazza, 12  
IT - 24020 Gorle (BG)

HAS BEEN RECOGNIZED FOR THE APPLICATION OF PROCEDURE

### CUSTOMERS' TESTING FACILITIES (CTFs) STAGE 2

AS DESCRIBED IN INTERNATIONAL DOCUMENTS IEC60068 / EN60068 / EN60917 AND IN IMQ  
RULES FOR RECOGNITION AND UTILIZATION OF TESTING FACILITIES IN THE PERFORMING OF TESTS  
COVERED IN THE SCOPE REPORTED IN THE ANNEX OF THIS RECOGNITION


(PRODUCT CATEGORIES: POW)

IMQ S.p.A. will accept the test results of the above testing laboratory  
as basis to issue its own certifications

На основание чл. 2  
от ЗЗЛД

First issue: 2017-11-06  
Expiry date: 2018-11-05



THE VALIDITY OF THIS RECOGNITION IS SUBJECT TO THE CONTINUOUS RESPECT OF  
RELEVANT IMQ RULES AND IS RELEVANT TO THE STANDARDS LISTED IN THE ANNEX TO  
THIS RECOGNITION



*Handwritten signature*

IECEE CTF | LOVATO ELECTRIC S.p.A. (LABORATORIO DI PROVA (LPR))  
 [311] | Standards in Scope Facebook Twitter LinkedIn Favorites Email Print

| Category | Standard                     | Tests/Clauses          | Acceptance Date | Responsible National Certification Body(s) |
|----------|------------------------------|------------------------|-----------------|--|
| POW      | IEC 60947-1:2007             | All clauses except 8.4 | 2017-11-06      | IMQ S.p.A.                                 |
| POW      | IEC 60947-1:2007/AMD1:2010   | All clauses except 8.4 | 2017-11-06      | IMQ S.p.A.                                 |
| POW      | IEC 60947-1:2007/AMD2:2014   | All clauses except 8.4 | 2017-11-06      | IMQ S.p.A.                                 |
| POW      | IEC 60947-4-1:2009           | All clauses except 9.4 | 2017-11-06      | IMQ S.p.A.                                 |
| POW      | IEC 60947-4-1:2009/AMD1:2012 | All clauses except 9.4 | 2017-11-06      | IMQ S.p.A.                                 |
| POW      | IEC 60947-5-1:2016           | All clauses            | 2017-11-06      | IMQ S.p.A.                                 |
| POW      | IEC 60947-5-1:2003           | All clauses            | 2017-11-06      | IMQ S.p.A.                                 |
| POW      | IEC 60947-5-1:2003/AMD1:2009 | All clauses            | 2017-11-06      | IMQ S.p.A.                                 |

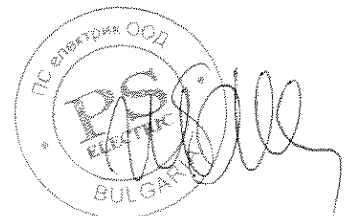

*Handwritten signature*